



South Coast Air Quality Management District

21865 Copley Drive, Diamond Bar, CA 91765-4178
(909) 396-2000 • www.aqmd.gov

August 4, 2010

Mr. David Ott
Environmental Programs Manager
Office of Environment, Health & Safety
University of California, Los Angeles
501 Westwood Plaza, 4th Flr. Box 951605
Los Angeles, CA 90095-1605

SUBJECT: Title V Facility Permit Revision (Facility ID: 018452)

Dear Mr. Ott:

Please find attached the revised Title Page, Table of Contents, Sections D and K and Appendix B of your Title V Facility Permit. The revised sections reflect the approval of the permit revision requested in your Application No. 503109. The proposed permit revision was submitted to EPA for 45-day review on June 11, 2010. This permit revision includes the change of ownership for two emergency internal combustion engines as follows:

Equipment	Application No.	Permit No.	Permit Type
Emergency Internal Combustion Engine	503209	G9381	P/O
Emergency Internal Combustion Engine	503210	G9382	P/O

Please review the attached sections carefully. Insert the enclosed sections into your Title V Facility Permit and discard the earlier versions. Questions concerning changes to your permit should be directed to Ms. Maria Vibal at (909) 396-2422.

Sincerely,

Brian L. Yeh
Senior Manager
General Commercial and Energy Team
Engineering and Compliance

BLY:AYL:RGC:MV: approval
Attachment

cc: Gerardo Rios, EPA Region IX



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

Title Page	
Facility ID:	018452
Revision #:	11
Date:	August 04, 2010

FACILITY PERMIT TO OPERATE


UNIVERSITY OF CALIFORNIA, LOS ANGELES
405 HILGARD AVE
LOS ANGELES, CA 90095

NOTICE

IN ACCORDANCE WITH RULE 206, THIS PERMIT TO OPERATE OR A COPY THEREOF MUST BE KEPT AT THE LOCATION FOR WHICH IT IS ISSUED.

THIS PERMIT DOES NOT AUTHORIZE THE EMISSION OF AIR CONTAMINANTS IN EXCESS OF THOSE ALLOWED BY DIVISION 26 OF THE HEALTH AND SAFETY CODE OF THE STATE OF CALIFORNIA OR THE RULES OF THE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT. THIS PERMIT SHALL NOT BE CONSTRUED AS PERMISSION TO VIOLATE EXISTING LAWS, ORDINANCES, REGULATIONS OR STATUTES OF ANY OTHER FEDERAL, STATE OR LOCAL GOVERNMENTAL AGENCIES.

Barry R. Wallerstein, D. Env.
EXECUTIVE OFFICER

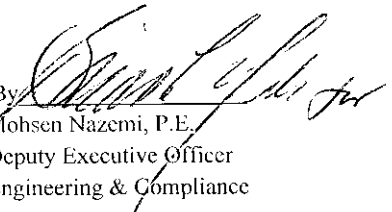By 
Mohsen Nazemi, P.E.
Deputy Executive Officer
Engineering & Compliance



AQMD

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

TABLE OF CONTENTS

Section	Description	Revision #	Date Issued
A	Facility Information	7	12/12/2007
B	RECLAIM Annual Emission Allocation	1	12/12/2007
C	Facility Plot Plan	TO BE DEVELOPED	
D	Facility Description and Equipment Specific Conditions	11	08/04/2010
E	Administrative Conditions	1	12/12/2007
F	RECLAIM Monitoring and Source Testing Requirements	1	12/12/2007
G	Recordkeeping and Reporting Requirements for RECLAIM Sources	1	12/12/2007
H	Permit To Construct and Temporary Permit to Operate	1	12/12/2007
I	Compliance Plans & Schedules	1	12/12/2007
J	Air Toxics	1	12/12/2007
K	Title V Administration	11	08/04/2010
Appendix			
A	NOx and SOx Emitting Equipment Exempt From Written Permit Pursuant to Rule 219	1	12/12/2007
B	Rule Emission Limits	10	08/04/2010



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

Facility Equipment and Requirements
(Section D)

This section consists of a table listing all permitted equipment at the facility, facility wide requirements, all individual Permits to Construct and Permits to Operate issued to various equipment at the facility, and Rule 219-exempt equipment subject to source-specific requirements. Each permit and Rule 219-exempt equipment will list operating conditions including periodic monitoring requirements, and applicable emission limits and requirements that the equipment is subject to. Also included is the rule origin and authority of each emission limit and permit condition.



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMITTED EQUIPMENT LIST

THE FOLLOWING IS A LIST OF ALL PERMITS TO CONSTRUCT AND PERMITS TO OPERATE AT THIS FACILITY:

Application No.	Permit to Operate Number	Equipment Description
225062	D71162	BOILER (5-20 MMBTU/HR) NAT GAS ONLY
225063	D71165	BOILER (5-20 MMBTU/HR) NAT GAS ONLY
231888	F01220	BOILER (>50 MMBTU/HR) NAT/PROC & DIST CG
246178	D48280	I C E (>500 HP) EM ELEC GEN DIESEL
246760	D38196	I C E (50-500 HP) EM ELEC GEN- DIESEL
256844	D44160	SPRAY BOOTH PAINT AND SOLVENT
283761	D75643	I C E (>500 HP) EM ELEC GEN DIESEL
285578	D77804	I C E (50-500 HP) EM ELEC GEN- DIESEL
285579	D77805	I C E (50-500 HP) EM ELEC GEN- DIESEL
285580	D77806	I C E (50-500 HP) EM ELEC GEN- DIESEL
285586	F2943	I C E (>500 HP) EM ELEC GEN DIESEL
293492	D99790	I C E (>500 HP) EM ELEC GEN DIESEL
293494	D98768	I C E (50-500 HP) EM ELEC GEN DIESEL
293496	F00370	I C E (50-500 HP) EM ELEC GEN- DIESEL
293498	F00371	I C E (>500 HP) EM ELEC GEN DIESEL
293499	D98801	I C E (50-500 HP) EM ELEC GEN- DIESEL
299891	D87699	I C E (>500 HP) EM ELEC GEN DIESEL
300226	D88255	I C E (>500 HP) EM ELEC GEN DIESEL
301583	D89155	I C E (50-500 HP) EM ELEC GEN- DIESEL
301724	D89196	I C E (>500 HP) EM ELEC GEN DIESEL
307859	F00255	TURBINE ENGINE (<=50 MW) NAT GAS-LDF GAS
307860	F00070	TURBINE ENGINE (<=50 MW) NAT GAS-LDF GAS
318723	F2279	I C E (50-500 HP) EM ELEC GEN- DIESEL



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

319009	F4805	I C E (50-500 HP) EM ELEC GEN-DIESEL
319012	F4808	I C E (50-500 HP) EM ELEC GEN-DIESEL
319015	F4807	I C E (50-500 HP) EM ELEC GEN-DIESEL
319016	F4681	I C E (50-500 HP) EM ELEC GEN-DIESEL
319017	F5269	I C E (50-500 HP) EM ELEC GEN-DIESEL
319020	F4806	I C E (50-500 HP) EM ELEC GEN-DIESEL
319021	F5268	I C E (50-500 HP) EM ELEC GEN-DIESEL
319025	F5266	I C E (50-500 HP) EM ELEC GEN-DIESEL
320232	F3116	I C E (50-500 HP) EM ELEC GEN-DIESEL
323826	F4983	I C E (50-500 HP) EM ELEC GEN-DIESEL
324434	F5492	I C E (50-500 HP) EM ELEC GEN-DIESEL
324436	F37549	I C E (50-500 HP) EM ELEC GEN-DIESEL
324438	F37540	I C E (50-500 HP) EM ELEC GEN-DIESEL
324439	F37551	I C E (>500 HP) EM ELEC GEN DIESEL
332786	F9960	I C E (50-500 HP) EM ELEC GEN-DIESEL
336111	F11549	I C E (>500 HP) EM ELEC GEN DIESEL
346215	F17312	I C E (>500 HP) EM ELEC GEN DIESEL
363084	F23691	I C E (>500 HP) EM ELEC GEN DIESEL
363085	F23692	I C E (>500 HP) EM ELEC GEN DIESEL
377360	F36980	I C E (>500 HP) EM ELEC GEN DIESEL
378897	F37887	I C E (50-500 HP) EM ELEC GEN DIESEL
378957	F38570	I C E (50-500 HP) EM ELEC GEN DIESEL
378959	F38571	I C E (>500 HP) EM ELEC GEN DIESEL
378960	F38572	I C E (50-500 HP) EM ELEC GEN DIESEL
383299	F37922	I C E (50-500 HP) EM ELEC GEN DIESEL
383303	F39010	I C E (50-500 HP) EM ELEC GEN



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

		DIESEL
398478	F49789	I C E (>500 HP) EM ELEC GEN DIESEL
400674	F52213	I C E (>500 HP) EM ELEC GEN DIESEL
400675	F52214	I C E (50-500 HP) EM ELEC GEN DIESEL
400702	F52215	I C E (50-500 HP) EM ELEC GEN DIESEL
408454	F56614	I C E (>500 HP) EM ELEC GEN DIESEL
409647	F58406	I C E (>500 HP) EM ELEC GEN DIESEL
409648	F58435	I C E (50-500 HP) EM ELEC GEN DIESEL
409649	F58436	I C E (50-500 HP) EM ELEC GEN DIESEL
415044	F62618	I C E (50-500 HP) EM ELEC GEN- DIESEL
406662	F81771	SELECTIVE CATALYTIC CONVERTER
406663	F81770	SELECTIVE CATALYTIC CONVERTER
431761	F71100	I C E (>500 HP) EM ELEC GEN DIESEL
431762	F71101	I C E (>500 HP) EM ELEC GEN DIESEL
438367	F73157	I C E (50-500 HP) EM ELEC GEN DIESEL
438553	F73384	I C E (>500 HP) EM ELEC GEN DIESEL
447811	F82410	I C E (>500 HP) EM ELEC GEN DIESEL
447812	F82411	I C E (>500 HP) EM ELEC GEN DIESEL
448155	F90961	I C E (>500 HP) EM ELEC GEN DIESEL
448157	F79657	BOILER (<5 MMBTU/HR) NAT GAS ONLY
448158	F78903	I C E (>500 HP) EM ELEC GEN DIESEL
448159	F78904	I C E (>500 HP) EM ELEC GEN DIESEL
448160	F78905	I C E (>500 HP) EM ELEC GEN DIESEL
448161	F78906	I C E (>500 HP) EM ELEC GEN DIESEL
448551	F82412	I C E (>500 HP) EM ELEC GEN DIESEL
451548	N19559	GASOLINE STORAGE & DISPENSING
455087	F89260	I C E (50-500 HP) EM ELEC GEN DIESEL
459848	F84400	I C E (>500 HP) EM ELEC GEN DIESEL
459849	F84399	I C E (>500 HP) EM ELEC GEN DIESEL
459850	F84398	I C E (>500 HP) EM ELEC GEN DIESEL
459851	F84397	I C E (>500 HP) EM ELEC GEN DIESEL
459852	F84396	I C E (>500 HP) EM ELEC GEN DIESEL
473877	F95749	I C E (50-500 HP) EM ELEC GEN DIESEL
473878	F95750	I C E (>500 HP) EM ELEC GEN DIESEL
475260	F95751	I C E (>500 HP) EM ELEC GEN DIESEL



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

481972	F97591	I C E (>500 HP) EM ELEC GEN DIESEL
498393	G3897	I C E (50-500 HP) EM ELEC GEN DIESEL
498553	G3896	I C E (50-500 HP) EM ELEC GEN DIESEL
503209	G9381	IC ENGINE (50-500 HP) EMERGENCY FIRE FIGHTING – DIESEL
503210	G9382	I C E (50-500 HP) EM ELEC GEN DIESEL

NOTE: EQUIPMENT LISTED ABOVE THAT HAVE NO CORRESPONDING PERMITS TO OPERATE NUMBER ARE ISSUED PERMITS TO CONSTRUCT OR ARE PROPOSED AS PERMITS TO OPERATE. THE ISSUANCE OR DENIAL OF THEIR PERMITS TO OPERATE IS SUBJECT TO ENGINEERING FINAL REVIEW. ANY OTHER APPLICATIONS THAT ARE STILL BEING PROCESSED AND HAVE NOT BEEN ISSUED PERMITS TO CONSTRUCT OR PERMITS TO OPERATE WILL NOT BE FOUND IN THIS TITLE V PERMIT.



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

FACILITY WIDE CONDITION(S)

Condition(s):

1. EXCEPT FOR OPEN ABRASIVE BLASTING OPERATIONS, THE OPERATOR SHALL NOT DISCHARGE INTO THE ATMOSPHERE FROM ANY SINGLE SOURCE OF EMISSIONS WHATSOEVER ANY AIR CONTAMINANT FOR A PERIOD OR PERIODS AGGREGATING MORE THAN THREE MINUTES IN ANY ONE HOUR WHICH IS:
 - A. AS DARK OR DARKER IN SHADE AS THAT DESIGNATED NO. 1 ON THE RINGLEMANN CHART, AS PUBLISHED BY THE UNITED STATES BUREAU OF MINES; OR
 - B. OF SUCH OPACITY AS TO OBSCURE AN OBSERVER'S VIEW TO A DEGREE EQUAL TO OR GREATER THAN DOES SMOKE DESCRIBED IN SUBPARAGRAPH (A) OF THIS CONDITION.
[RULE 401]
2. THE OPERATOR SHALL NOT PURCHASE ANY DIESEL FUEL UNLESS THE FUEL IS LOW SULFUR DIESEL FOR WHICH THE SULFUR CONTENT SHALL NOT EXCEED 15 PPM BY WEIGHT AS SUPPLIED BY THE SUPPLIER.
[RULE 431.2]
3. THE OPERATOR SHALL NOT USE OR SELL GASEOUS FUEL CONTAINING SULFUR COMPOUNDS IN EXCESS OF 40 PPMV CALCULATED AS HYDROGEN SULFIDE AVERAGED OVER FOUR HOURS.
[RULE 431.1]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. D71162
A/N 225062**

Equipment Description:

BOILER, CLEAVER BROOKS, FIRETUBE TYPE, MODEL CB700-300, RATED AT 12,555,000 BTU PER HOUR, NATURAL GAS-FIRED, WITH A CLEAVER BROOKS BURNER AND A FORCED FLUE GAS RECIRCULATION SYSTEM (LOCATED AT THE MEDICAL PLAZA).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS BOILER SHALL BE FIRED ONLY WITH NATURAL GAS.
[RULE 1303 (a)(1)]
4. THE FLUE GAS RECIRCULATION SYSTEM SHALL BE IN FULL USE WHENEVER THE BOILER STACK TEMPERATURE EXCEEDS 200 DEGREES FAHRENHEIT. THE OXIDES OF NITROGEN (NO_x) SHALL NOT EXCEED 40 PPM, CALCULATED AS NO₂, AND THE EMISSIONS OF CARBON MONOXIDE (CO) SHALL NOT EXCEED 400 PPM, BOTH MEASURED BY VOLUME ON A DRY BASIS AT 3% O₂, AND AVERAGED OVER A MINIMUM OF 15 CONSECUTIVE MINUTES. THE OWNER OR OPERATOR OF THIS BOILER SHALL MAINTAIN A COPY OF THE SOURCE TEST WHICH DEMONSTRATES COMPLIANCE AND THIS REPORT SHALL BE MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1303 (a)(1)]
5. AN INDICATING INSTRUMENT SHALL BE INSTALLED AND MAINTAINED TO ADEQUATELY MEASURE THE BOILER STACK TEMPERATURE.
[RULE 1303 (a)(1)]

Emissions And Requirements:

6. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

CO: 2000 PPMV, RULE 407
PM: 0.1 GR/SCF, RULE 409
CO: 400 PPMV, RULE 1303 (a)(1)
NOX: 40 PPMV, RULE 1303 (a)(1)



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

Section D	Page 8
Facility I.D.#:	018452
Revision #:	11
Date:	August 04, 2010

FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

NOX: 30 PPMV, RULE 1146
CO: 400 PPMV, RULE 1146



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D71165
A/N 225063

Equipment Description:

BOILER, CLEAVER BROOKS, FIRETUBE TYPE, MODEL CB700-300, RATED AT 12,555,000 BTU PER HOUR, NATURAL GAS-FIRED, WITH A CLEAVER BROOKS BURNER AND A FORCED FLUE GAS RECIRCULATION SYSTEM (LOCATED AT THE MEDICAL PLAZA).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS BOILER SHALL BE FIRED ONLY WITH NATURAL GAS.
[RULE 1303 (a)(1)]
4. THE FLUE GAS RECIRCULATION SYSTEM SHALL BE IN FULL USE WHENEVER THE BOILER STACK TEMPERATURE EXCEEDS 200 DEGREES FAHRENHEIT. THE OXIDES OF NITROGEN (NO_x) SHALL NOT EXCEED 40 PPM, CALCULATED AS NO₂, AND THE EMISSIONS OF CARBON MONOXIDE (CO) SHALL NOT EXCEED 400 PPM, BOTH MEASURED BY VOLUME ON A DRY BASIS AT 3% O₂, AND AVERAGED OVER A MINIMUM OF 15 CONSECUTIVE MINUTES. THE OWNER OR OPERATOR OF THIS BOILER SHALL MAINTAIN A COPY OF THE SOURCE TEST WHICH DEMONSTRATES COMPLIANCE AND THIS REPORT SHALL BE MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1303 (a)(1)]
5. AN INDICATING INSTRUMENT SHALL BE INSTALLED AND MAINTAINED TO ADEQUATELY MEASURE THE BOILER STACK TEMPERATURE.
[RULE 1303 (a)(1)]

Emissions And Requirements:

6. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

CO: 2000 PPMV, RULE 407
PM: 0.1 GR/SCF, RULE 409
CO: 400 PPMV, RULE 1303 (a)(1)
NOX: 40 PPMV, RULE 1303 (a)(1)



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

Section D	Page 10
Facility I.D.#:	018452
Revision #:	11
Date:	August 04, 2010

FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

NOX: 30 PPMV, RULE 1146
CO: 400 PPMV, RULE 1146



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F01220
A/N 231888

Equipment Description:

BOILER (AUXILIARY), ZURN/KEYSTONE, MODEL NO. 1832, RATED AT 224.4 MILLION BTU PER HOUR, WITH COEN LOW NOX BURNER, NATURAL GAS OR FUEL OIL, FLUE GAS RECIRCULATION SYSTEM, AND OXYGEN TRIM, BACKUP TO THE COGENERATION SYSTEM.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED AND MAINTAINED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 1303 (a)(1)]
4. THIS BOILER SHALL BE EQUIPPED WITH A FLOW MONITORING DEVICE WHICH SHALL MEASURE AND RECORD EACH FUEL (BOTH NATURAL GAS AND FUEL OIL) CONSUMPTION (IN MILLION BTU'S PER HOUR).
[RULE 1146]
5. THE FLUE GAS RECIRCULATION SYSTEM SHALL BE IN FULL OPERATION WHENEVER THIS BOILER IS IN OPERATION.
[RULE 1303 (a)(1)]
6. THE EMISSIONS OF OXIDES OF NITROGEN AS NO₂ FROM THE BOILER SHALL NOT EXCEED 40 PPMV MEASURED AT 3 PERCENT OXYGEN, EXCEPT DURING START-UPS AND SHUT-DOWNS.
[RULE 1303 (a)(1)]
7. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE, OVER A FIFTEEN MINUTE AVERAGE TIME PERIOD, AND RECORD THE AUXILIARY BOILER EXHAUST STACK FOR NO_x, CO AND O₂ CONCENTRATIONS, ON A DRY BASIS. THE SYSTEM SHALL ALSO CONVERT THE ACTUAL NO_x AND CO CONCENTRATIONS TO A CORRECTED CONCENTRATION AT 3 PERCENT OXYGEN, ON A DRY BASIS, AND CONTINUOUSLY RECORD THE CORRECTED STACK NO_x AND CO CONCENTRATIONS. IN ADDITION, THE SYSTEM SHALL MONITOR AND RECORD THE DAILY NO_x AND CO EMISSIONS IN POUNDS PER DAY FROM THE BOILER. THIS MONITORING SYSTEM SHALL BE CERTIFIED TO COMPLY WITH THE REQUIREMENTS OF RULE 218.
[RULE 1146, RULE 218]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

8. THE BOILER MAY ONLY FIRE FUEL OIL WHEN NATURAL GAS SUPPLY TO UCLA IS UNAVAILABLE, EXCEPT DURING TESTING.
[RULE 1303 (a)(1)]
9. FOR TESTING PURPOSES, THIS BOILER SHALL NOT BE OPERATED WITH FUEL OIL FOR MORE THAN 8 HOURS PER DAY OR 100 HOURS PER YEAR.
[RULE 1303 (a)(1), RULE 1303 (b)(2)]
10. ONLY ONE OF THE TWO GAS TURBINES (NO. 1 AND NO. 2) MAY OPERATE SIMULTANEOUSLY WITH THIS AUXILIARY BOILER.
[RULE 1303 (a)(1), RULE 1303 (b)(2)]
11. WHEN THE AUXILIARY BOILER IS FIRING NATURAL GAS, THE EMISSIONS FROM THE AUXILIARY BOILER EXHAUST STACK, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING POUND PER DAY LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
40	301	3	230	29

[RULE 1303 (b)(2)]

12. WHEN THE AUXILIARY BOILER IS FIRING NATURAL GAS, THE EMISSIONS FROM THE AUXILIARY BOILER EXHAUST STACK, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING POUND PER HOUR LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
1.7	12.5	0.13	9.6	1.2

[RULE 1303 (b)(2)]

13. WHEN THE AUXILIARY BOILER IS FIRING FUEL OIL, THE EMISSIONS FROM THE AUXILIARY BOILER EXHAUST STACK, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING POUND PER DAY LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
37	298	276	192	201

[RULE 1303 (b)(2)]

14. WHEN THE AUXILIARY BOILER IS FIRING FUEL OIL, THE EMISSIONS FROM THE AUXILIARY BOILER EXHAUST STACK, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING POUND PER HOUR LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
1.5	12.4	11.5	8	8.4

[RULE 1304 (c)(4)]

15. THE MAXIMUM QUANTITY OF THE FUEL USED SHALL NOT EXCEED THE EQUIVALENT OF 224 MILLION BTU'S PER HOUR BASED ON THE LOWER HEATING VALUE OF THE FUEL.
[RULE 1303 (a)(1)]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

16. THE MAXIMUM QUANTITY OF THE FUEL USED SHALL NOT EXCEED THE EQUIVALENT OF 490,560 MILLION BTU'S IN ANY ONE YEAR BASED ON THE LOWER HEATING VALUE OF THE FUEL.
[RULE 1146]
17. ALL CONCENTRATIONS OF GASEOUS EMISSIONS SHALL BE EXPRESSED IN PARTS PER MILLION BY VOLUME CORRECTED TO 3 PERCENT OXYGEN DRY AND SHALL BE MEASURED OVER FOUR CONSECUTIVE FIFTEEN-MINUTE AVERAGE TIME PERIODS IN ANY ONE HOUR.
[RULE 1303 (a)(1)]
18. THE OPERATOR SHALL KEEP THE FOLLOWING RECORDS:
- A. DATES AND TIMES OF START-UPS AND SHUT-DOWNS
 - B. QUANTITY OF NATURAL GAS AND FUEL OIL BURNED
 - C. DAILY LOG SHOWING THE REASONS WHY NATURAL GAS WAS NOT USED AND THE NUMBER OF HOURS DURING WHICH BACK-UP FUEL WAS USED
 - D. THE RESULTS FROM THE MONITORS REQUIRED BY PERMIT CONDITION NOS. 4 AND 8.

RECORDS OF THE OPERATION OF THE AUXILIARY BOILER SHALL BE MAINTAINED BY UCLA AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 1146]

Periodic Monitoring:

19. THE OPERATOR SHALL CONDUCT AN INSPECTION FOR VISIBLE EMISSION FROM ALL STACKS AND OTHER EMISSION POINTS OF THIS EQUIPMENT WHENEVER THIS EQUIPMENT HAS COMBUSTED ONE MILLION GALLONS OF DIESEL FUEL, TO BE COUNTED CUMULATIVELY OVER A FIVE YEAR PERIOD. THE INSPECTION SHALL BE CONDUCTED WHILE THE EQUIPMENT IS IN OPERATION AND DURING DAYLIGHT HOURS. IF ANY VISIBLE EMISSIONS (NOT INCLUDING CONDENSED WATER VAPOR) ARE DETECTED THAT LAST MORE THAN THREE MINUTES IN ANY ONE HOUR, THE OPERATOR SHALL EITHER:
- A. TAKE CORRECTIVE ACTION(S) THAT ELIMINATES THE VISIBLE EMISSIONS WITHIN 24 HOURS AND REPORT THE VISIBLE EMISSIONS AS A POTENTIAL DEVIATION IN THE SAME FASHION AS DEVIATIONS ARE REQUIRED TO BE REPORTED IN SECTION K OF THIS PERMIT;
OR
 - B. HAVE A CARB-CERTIFIED SMOKE READER DETERMINE COMPLIANCE WITH THE OPACITY STANDARD, USING EPA METHOD 9 OR THE PROCEDURES IN THE CARB MANUAL "VISIBLE EMISSION EVALUATION", WITHIN THREE BUSINESS DAYS AND REPORT ANY DEVIATIONS TO AQMD.

IN ADDITION, THE OPERATOR SHALL KEEP THE RECORDS IN ACCORDANCE WITH THE RECORDKEEPING REQUIREMENTS IN SECTION K OF THIS PERMIT AND THE FOLLOWING RECORDS:

- A. STACK OR EMISSION POINT IDENTIFICATION;
- B. DESCRIPTION OF ANY CORRECTIVE ACTIONS TAKEN TO ABATE VISIBLE EMISSIONS;



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

- C. DATE AND TIME VISIBLE EMISSION WAS ABATED; AND
D. VISIBLE EMISSION OBSERVATION RECORDED BY A CERTIFIED SMOKE READER.
[RULE 3004 (a)(4)]

20. UNITS WITH AN ANNUAL OIL USAGE GREATER THAN 2,000,000 GALLONS IN ANY ONE YEAR THE OPERATOR SHALL CONDUCT SOURCE TESTING FOR PARTICULATE MATTER ONCE EVERY FIVE YEARS. THE OPERATOR SHALL CONDUCT AN ANNUAL MAINTENANCE INSPECTION CHECK OF THE OPERATING PRESSURE, TEMPERATURE, AIR SUPPLY, VENT, SMOKE SPOT, BURNER CONDITION, HEAT-TRANSFER SURFACE CONDITION, WATER TREATMENT, BLOWDOWN AND LEAKAGE

THE OPERATOR SHALL KEEP THE RECORDS IN ACCORDANCE WITH THE RECORDKEEPING REQUIREMENTS IN SECTION K OF THIS PERMIT AND THE FOLLOWING RECORDS:

- A. DATE WHEN ANNUAL MAINTENANCE INSPECTION WAS CONDUCTED.
B. DATE WHEN SOURCE TEST FOR PARTICULATE MATTER WAS CONDUCTED.
[RULE 3004 (a)(4)]

21. UNITS WITH A HEAT INPUT GREATER THAN 10 MMBTU/HR AND ANNUAL OIL USAGE GREATER THAN 1,000,000 GALLONS OR GREATER THAN 336 HOURS OF OPERATION, BUT DOES NOT EXCEED 2,000,000 GALLONS IN ANY ONE YEAR. THE OPERATOR SHALL CONDUCT AN ANNUAL MAINTENANCE INSPECTION CHECK OF THE OPERATING PRESSURE, TEMPERATURE, AIR SUPPLY, VENT, SMOKE SPOT, BURNER CONDITION, HEAT-TRANSFER SURFACE CONDITION, WATER TREATMENT, BLOWDOWN AND LEAKAGE.

THE OPERATOR SHALL KEEP THE RECORDS IN ACCORDANCE WITH THE RECORDKEEPING REQUIREMENTS IN SECTION K OF THIS PERMIT AND THE FOLLOWING RECORDS:

- A. DATE WHEN ANNUAL MAINTENANCE INSPECTION WAS CONDUCTED.
[RULE 3004 (a)(4)]

Emissions And Requirements:

22. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:
- CO: 2000 PPMV, RULE 407
 - PM: 0.1 GR/SCF, RULE 409
 - CO: 400 PPMV, RULE 1146
 - NOX: 40 PPMV, RULE 1303 (a)(1)
 - NOX: 30 PPMV, RULE 1146
 - NOX: 125 PPMV, GAS, RULE 476
 - NOX: 225 PPMV, FUEL OIL, RULE 476



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D48280
A/N 246178

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, MODEL NO. 3412, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, TURBOCHARGED, AFTERCOOLED, 12 CYLINDERS, 890 BHP (LOCATED AT MRL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. EXCEPT FOR MAINTENANCE TESTING PURPOSES, THIS ENGINE MAY ONLY OPERATE DURING UTILITY FAILURE PERIODS.
[RULE 1304 (a)(4)]
7. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:
- PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D38196
A/N 246760

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 3306TA, SERIAL NO. 2AJ00405, 6 CYLINDERS, FOUR CYCLE, TURBOCHARGED, AFTERCOOLED, 339 BHP, WITH 1 EXHAUST (LOCATED AT COVEL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN ELAPSED TIME METER SHALL BE INSTALLED/MAINTAINED, SO AS TO INDICATE IN CUMULATIVE HOURS, THE AMOUNT OF TIME THE ENGINE HAS OPERATED.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT OPERATE MORE THAN 125 HOURS (CUMULATIVE) IN ANY ONE CALENDAR YEAR UNLESS ADDITIONAL HOURS ARE OTHERWISE AUTHORIZED BY THE EXECUTIVE OFFICER. THIS EQUIPMENT SHALL ONLY OPERATE DURING MAINTENANCE TESTING, PERFORMANCE TESTING, OR IN CASES OF EMERGENCY.
[RULE 1303 (a)(1), RULE 1304 (a)(4)]
5. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 20 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
6. THE UNCONTROLLED EMISSION RATE OF REACTIVE ORGANIC GASES SHALL NOT EXCEED 0.13 LB/HR; THE UNCONTROLLED EMISSION RATE OF OXIDE OF NITROGEN SHALL NOT EXCEED 5.9 LB/HR.
[RULE 1303 (a)(1), RULE 1304 (a)(4)]
7. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE RETARDED A MINIMUM OF 4° (FOUR DEGREES) RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

8. THE IGNITION TIMING OF THIS ENGINE SHALL BE INSPECTED, ADJUSTED, AND CERTIFIED, AT A MINIMUM, ONCE EVERY THREE YEARS OF OPERATION. INSPECTIONS, ADJUSTMENTS, AND CERTIFICATIONS SHALL BE PERFORMED BY A QUALIFIED MECHANIC AND ACCORDING TO THE ENGINE MANUFACTURER'S PROCEDURES.
[RULE 1303 (a)(1)]
9. AN OPERATING RECORD OF THIS ENGINE SHALL BE MAINTAINED IN A FORMAT APPROVED IN WRITING BY THE DIRECTOR OF ENFORCEMENT. THE RECORD SHALL INCLUDE, AT A MINIMUM THE HOURS AND DAYS OF OPERATION AND THE QUANTITY OF FUEL USED. THE OPERATING RECORD SHALL BE KEPT FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE UPON REQUEST OF DISTRICT PERSONNEL
[RULE 1303 (a)(1), RULE 1304 (a)(4)]
10. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
11. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
12. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

13. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. D44160
A/N 256844**

Equipment Description:

SPRAY BOOTH, BINKS, MODEL WE-30-10TLS, WATER WASH TYPE, 30'-0" W. X 12'-2" D. X 12'-7" H., WITH TWO 7.5 H.P. EXHAUST FANS AND TWO 7.5 H.P. PUMPS (LOCATED AT CSBI).

Conditions

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS BOOTH SHALL NOT BE OPERATED UNLESS THE WATER-WASH UNIT IS PROPERLY MAINTAINED AND IN FULL OPERATION.
[RULE 1303 (a)(1)]
4. COATINGS, REDUCERS, CLEAN-UP SOLVENTS AND ANY OTHER MATERIALS USED IN THIS EQUIPMENT SHALL NOT CONTAIN ANY COMPOUND IDENTIFIED AS CARCINOGENIC CONTAMINANTS IN RULE 1401.
[RULE 1401]
5. THE TOTAL QUANTITY OF VOLATILE ORGANIC EMISSIONS DISCHARGED TO THE ATMOSPHERE FROM THIS EQUIPMENT SHALL NOT EXCEED 55 POUNDS IN ANY ONE DAY.
[RULE 1303 (a)(1), RULE 1303 (b)(2)]
6. THIS EQUIPMENT SHALL BE OPERATED IN COMPLIANCE WITH RULES 1107 WHEN COATING METAL PARTS AND 1136 WHEN COATING WOOD PARTS.
[RULE 1107, RULE 1136]
7. THE OPERATOR SHALL KEEP ADEQUATE RECORDS TO VERIFY DAILY USAGE AND DAILY VOC EMISSIONS IN ACCORDANCE WITH RULE 109. SUCH RECORDS SHALL BE RETAINED FOR A PERIOD OF FIVE YEARS AND BE MADE AVAILABLE UPON REQUEST OF THE EXECUTIVE OFFICER OR HIS REPRESENTATIVE.
[RULE 109]
8. THIS EQUIPMENT SHALL COMPLY WITH RULE 1171.
[RULE 1171]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

Periodic Monitoring:

9. THE OPERATOR SHALL NOT OPERATE THIS EQUIPMENT UNLESS THE WATER WASH UNIT IS PROPERLY MAINTAINED AND IN FULL OPERATION WITH THE WATER CURTAIN COMPLETELY COVERING THE EXHAUST SECTION OF THE BOOTH. THE OPERATOR SHALL ALSO PERFORM A WEEKLY INSPECTION OF THE WATER CURTAIN INTEGRITY. THE OPERATOR SHALL KEEP RECORDS, IN A MANNER APPROVED BY THE DISTRICT, FOR THE FOLLOWING PARAMETER(S) OR ITEM(S):
 - A. THE NAME OF THE PERSON PERFORMING THE INSPECTION AND/OR MAINTENANCE OF THE WATER WASH;
 - B. THE DATE, TIME AND RESULTS OF THE INSPECTION; AND
 - C. THE DATE, TIME AND DESCRIPTION OF ANY MAINTENANCE OR REPAIRS RESULTING FROM THE INSPECTION.[RULE 3004 (a)(4)]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:
 - VOC: RULE 109
 - VOC: RULE 1107, SEE APPENDIX B FOR EMISSIONS LIMITS
 - VOC: RULE 1136, SEE APPENDIX B FOR EMISSIONS LIMITS
 - VOC: RULE 1171, SEE APPENDIX B FOR EMISSIONS LIMITS
 - PM: RULE 481
 - PM: RULE 404, SEE APPENDIX B FOR EMISSIONS LIMITS



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D75643
A/N 283761

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS, 16 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. KTTA50-G2, SERIAL NO. 33122288, DIESEL-FUELED, 2220 BHP, DRIVING AN EMERGENCY ELECTRICAL GENERATION (LOCATED AT CO-GEN).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED, WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

Section D	Page 22
Facility I.D.#:	018452
Revision #:	11
Date:	August 04, 2010

**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. **D77804**
A/N 285578

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL ALLISON, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL 7A0157, SERIAL NO. VC3585037, 16 CYLINDERS, TURBOCHARGED, 400 BHP, LOCATED ON ROOF, UNIT #2.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED AND MAINTAINED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG, LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. EXCEPT FOR MAINTENANCE TESTING PURPOSES, THIS ENGINE SHALL ONLY OPERATE DURING UTILITY FAILURE PERIODS
[RULE 1303 (a)(1), RULE 1304 (a)(4)]
7. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
8. HIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D77805
A/N 285579

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL 3306B(D1)-2AJ00248, SERIAL NO. 5WF00342, 6 CYLINDERS, TURBOCHARGED, 335 BHP, LOCATED AT 300 MEDICAL PLAZA (ROOF).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED AND MAINTAINED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG, LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. EXCEPT FOR MAINTENANCE TESTING PURPOSES, THIS ENGINE SHALL ONLY OPERATE DURING UTILITY FAILURE PERIODS.
[RULE 1303 (a)(1), RULE 1304 (a)(4)]
7. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. D77806
A/N 285580**

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL ALLISON, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL 7A0157, SERIAL NO. VC3558837, 16 CYLINDERS, TURBOCHARGED, 400 BHP, LOCATED ON ROOF, UNIT #1 (200 MEDICAL PLAZA).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED AND MAINTAINED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG, LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. EXCEPT FOR MAINTENANCE TESTING PURPOSES, THIS ENGINE SHALL ONLY OPERATE DURING UTILITY FAILURE PERIODS.
[RULE 1303 (a)(1), RULE 1304 (a)(4)]
7. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. F2943
A/N 285586**


Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS MODEL NO. KTTA19GA, 12 CYLINDERS, TURBOCHARGED, AFTERCOOLED, 750 BHP, DIESEL-FUELED, EMERGENCY STANDBY, DRIVING AN ELECTRICAL GENERATOR (LOCATED AT MEDICAL PLAZA PARKING).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED AND MAINTAINED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG, LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D99790
A/N 293492

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL 16V-92TA, 8163-7405, 16 CYLINDERS, 1095 BHP, TURBOCHARGED, AFTERCOOLED, DIESEL-FUELED, EMERGENCY STANDBY, DRIVING AN ELECTRICAL GENERATOR (LOCATED AT SEAS).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME (IN HOURS), AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARD RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D98768
A/N 293494

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, MODEL 3208D, SERIAL #30A00916, 8 CYLINDERS, TURBOCHARGED, 235 BHP, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION (LOCATED AT ROYCE HALL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME (IN HOURS), AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F00370
A/N 293496

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS MODEL #NT 855 G3, 6 CYLINDERS, TURBOCHARGED, 390 BHP, DIESEL-FUELED, EMERGENCY STANDBY, DRIVING AN ELECTRICAL GENERATOR (LOCATED AT FLOWLER).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME (IN HOURS), AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

Section D Page 36
Facility I.D.#: 018452
Revision #: 11
Date: August 04, 2010

FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F00371
A/N 293498

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL MODEL 16V-92TA, 8163-7416, 16 CYLINDERS, 1232 BHP, TURBOCHARGED, AFTERCOOLED, DIESEL-FUELED, EMERGENCY STANDBY, DRIVING AN ELECTRICAL GENERATOR (LOCATED AT MSB).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME (IN HOURS), AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 1.7 DEGREES RETARDED RELATIVE TO PRODUCTION TIMING AS ESTABLISHED BY DETROIT DIESEL IN ITS PRODUCT ANNOUNCEMENT "INJECTION TIMING RETARD INSTRUCTIONS FOR CONFORMANCE WITH THE SCAQMD'S GENERAL PERMIT REGISTRATION PROGRAM 16-92TA GENERATOR SET ENGINE MODEL 8163-7416".
[RULE 1303 (a)(1)]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D98801
A/N 293499

Equipment Description:

INTERNAL COMBUSTION ENGINE, EMERGENCY STANDBY, CUMMINS MODEL 6BT5.9-G2, SERIAL #44155853, 6 CYLINDERS, TURBOCHARGED, 166 BHP, DIESEL-FUELED, DRIVING AN ELECTRICAL GENERATOR (LOCATED AT BOELTER).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE INSTALLED SO AS TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME (IN HOURS), AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D87699
A/N 299891

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS, 12 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. KTA38-G4, 1490 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT AGSM).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. THIS ENGINE SHALL NOT BE OPERATED FOR NON-EMERGENCY USE BETWEEN THE HOURS OF 7:30 A.M. AND 3:30 P.M. ON DAYS WHEN SCHOOL IS IN SESSION.
[RULE 1470]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

Section D Page 42
Facility I.D.#: 018452
Revision #: 11
Date: August 04, 2010

FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D88255
A/N 300226

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, 12 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. 9123-7416 (12V-149T1B), 1750 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT YOUNG HALL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D89155
A/N 301583

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, 6 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. 3406 DITA (300 KW), 443 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT BOELTER HALL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. D89196
A/N 301724

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, 12 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. 3412 DITTA (500 KW), 746 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR. (LOCATED AT ACKERMAN).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO PRODUCTION TIMING AS ESTABLISHED BY CATERPILLAR IN PRODUCT NEWS BULLETIN '3412 DITTA 500 KW CALIFORNIA CONFIGURATION'.
[RULE 1303 (a)(1)]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. R-F00255
A/N 307859

Equipment Description:

COGENERATION SYSTEM NO. 1 CONSISTING OF:

1. GAS TURBINE NO. 1, GENERAL ELECTRIC, MODEL LM1600, RATED AT 140.34 MMBTU/HR, NATURAL GAS, BLENDED NATURAL AND LANDFILL GAS, OR FUEL OIL FIRED, WITH A WATER INJECTION SYSTEM, DRIVING A 14.4 MW ELECTRICAL GENERATOR.
2. WASTE HEAT BOILER NO. 1, DELTAK CORPORATION, PRODUCING 117,000 LB/HR OF SUPERHEATED STEAM AT 660 PSIG AND 41,200 LB/HR OF SATURATED STEAM AT 15 PSIG, WITH AN 86 MMBTU/HR NATURAL GAS OR BLENDED NATURAL GAS AND LANDFILL GAS FIRED DUCT BURNER, SUPERHEATER, EVAPORATOR, ECONOMIZER, FEEDWATER PREHEATER, AND A CONTINUOUS EMISSIONS MONITOR.
3. THREE (3) NATURAL GAS COMPRESSORS, KCI, INC., 350 HP EACH, AND ONE (1) LANDFILL GAS COMPRESSOR, KCI, INC., 1250 HP (COMMON TO COGENERATION SYSTEM NO. 2)
4. ONE STEAM TURBINE, SHIN NIPPON MACHINERY CO, LTD., 14.5 MW, WITH A WATER COOLED CONDENSER AND COOLING TOWER (COMMON TO COGENERATION SYSTEM NO. 2)

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED AND MAINTAINED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
4. THIS EQUIPMENT SHALL NOT BE OPERATED UNLESS IT IS VENTED TO AIR POLLUTION CONTROL EQUIPMENT WHICH IS IN FULL USE AND WHICH HAS A VALID PERMIT ISSUED BY THE AQMD.
[RULE 1303 (a)(1), RULE 1134]
5. WATER INJECTION SHALL BE USED DURING OPERATION OF THE GAS TURBINE EXCEPT DURING START-UP AND SHUT-DOWN.
[RULE 1303 (a)(1), RULE 1134]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

6. THE DUCT BURNER SHALL ONLY BE FIRED WITH NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, AND SHALL NOT BE OPERATED WHEN THE GAS TURBINE IS FIRED WITH FUEL OIL, EXCEPT DURING TESTING.
[RULE 1303 (a)(1), RULE 1134]
7. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MONITOR AND RECORD THE FUEL CONSUMPTION AND THE MASS RATIO OF WATER TO FUEL BEING FIRED IN THE TURBINE. THIS SYSTEM SHALL BE ACCURATE TO WITHIN PLUS OR MINUS 5.0 PERCENT.
[RULE 1303 (a)(1), RULE 1134]
8. THE DUCT BURNER SHALL BE EQUIPPED WITH A FLOW MONITORING DEVICE WHICH SHALL MEASURE AND RECORD THE FUEL CONSUMPTION (IN MILLION BTU'S PER HOUR) IN THE BURNER.
[RULE 1303 (a)(1)]
9. THE GAS TURBINE SHALL BE EQUIPPED WITH A FLOW MONITORING DEVICE WHICH SHALL MEASURE AND RECORD EACH FUEL (NATURAL GAS, LANDFILL GAS, AND FUEL OIL) CONSUMPTION (IN MILLION BTU'S PER HOUR).
[RULE 1303 (a)(1)]
10. A CONTINUOUS MONITORING AND RECORDING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE AND RECORD THE MOLE RATIO OF INJECTED AMMONIA (NH₃) TO SCR INLET NOX. THIS SYSTEM SHALL BE ACCURATE TO WITHIN PLUS OR MINUS 5.0 PERCENT.
[RULE 1303 (a)(1)]
11. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE, OVER A FIFTEEN CONSECUTIVE MINUTE AVERAGE TIME PERIOD, AND RECORD THE WASTE HEAT RECOVERY BOILER EXHAUST STACK FOR NOX, CO AND O₂ CONCENTRATIONS, ON A DRY BASIS. THE SYSTEM SHALL ALSO CONVERT THE ACTUAL NOX AND CO CONCENTRATIONS TO A CORRECTED CONCENTRATION AT 15 PERCENT OXYGEN, ON A DRY BASIS, AND CONTINUOUSLY RECORD THESE CORRECTED STACK NOX, CO AND O₂ CONCENTRATIONS. IN ADDITION, THE SYSTEM SHALL MONITOR AND RECORD THE DAILY NOX AND CO EMISSIONS IN POUNDS PER DAY FROM THE COGENERATION SYSTEM/WASTE HEAT BOILER/EXHAUST STACK. THIS MONITORING SYSTEM SHALL BE CERTIFIED TO COMPLY WITH THE REQUIREMENTS OF RULE 218.
[RULE 1134, RULE 1303 (a)(1), RULE 1303 (b)(2), RULE 218]
12. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE AND RECORD THE VOLUMETRIC FLOW RATE IN THE EXHAUST STACK. THIS MONITORING SYSTEM SHALL COMPLY WITH THE REQUIREMENTS OF RULE 218.
[RULE 1303 (a)(1), RULE 1303(b)(2), RULE 218]
13. THE GAS TURBINE SHALL ONLY FIRE NATURAL GAS OR A BLEND OF LANDFILL GAS AND NATURAL GAS, EXCEPT DURING TESTING, UNLESS NATURAL GAS IS UNAVAILABLE.
[RULE 1303 (a)(1)]
14. ONLY ONE OF THE GAS TURBINES SHALL BE OPERATED SIMULTANEOUSLY WITH THE AUXILIARY BOILER.
[RULE 1303 (b)(2)]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

15. WHEN THE TURBINE IS FIRING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER DAY LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
31	121	2	124	30
[RULE 1303 (b)(2)]				

16. WHEN THE TURBINE IS FIRING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER HOUR LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
1.3	5.0	0.1	5.2	1.25
[RULE 1303 (b)(2)]				

17. WHEN THE TURBINE IS FIRING FUEL OIL, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER DAY LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
26	89	118	98	125
[RULE 1303 (b)(2)]				

18. WHEN THE TURBINE IS FIRING FUEL OIL, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER HOUR LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
1.1	3.7	4.9	4.1	5.2
[RULE 1303 (b)(2)]				

19. EMISSIONS OF OXIDES OF NITROGEN, AS NO₂, FROM THE WASTE HEAT BOILER EXHAUST SHALL NOT EXCEED 6 PPMV, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]

20. EMISSIONS OF CARBON MONOXIDE (CO) FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 10 PPMV DURING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS FIRING AND 13 PPMV DURING FUEL OIL FIRING, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]

21. EMISSIONS OF AMMONIA (NH₃) FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 20 PPMV, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

22. ALL CONCENTRATIONS OF GASEOUS EMISSIONS SHALL BE EXPRESSED IN PARTS PER MILLION BY VOLUME CORRECTED TO 15% OXYGEN, DRY, AND SHALL BE MEASURED OVER FOUR CONSECUTIVE FIFTEEN MINUTE AVERAGE TIME PERIODS IN ANY ONE HOUR.
[RULE 1303 (a)(1)]
23. SAMPLING PORTS SHALL BE MAINTAINED IN THE GAS TURBINE EXHAUST DUCT AND WASTE HEAT BOILER EXHAUST DUCT 8-10 DUCT DIAMETERS DOWNSTREAM AND TWO (2) EQUIVALENT DUCT DIAMETERS UPSTREAM OF ANY FLOW DISTURBANCE AND SHALL CONSIST OF TWO 4-INCH WELDED NIPPLES WITH CAPS. OWNER/OPERATOR SHALL PROVIDE ADEQUATE AND SAFE ACCESS TO THE TEST PORTS. AN EQUIVALENT METHOD SHALL BE USED UPON PRIOR APPROVAL BY THE AQMD.
[RULE 217]
24. WITHIN 30 DAYS OF THE ANNIVERSARY OF THE INITIAL PERFORMANCE TEST, UNLESS OTHERWISE APPROVED BY THE AQMD, UCLA SHALL CONDUCT ANNUAL PERFORMANCE TESTS IN ACCORDANCE WITH AQMD TEST PROCEDURES AND FURNISH THE AQMD WRITTEN RESULTS OF SUCH PERFORMANCE TESTS WITHIN 45 DAYS AFTER TESTING. ALL SOURCE TESTING PROCEDURES AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE AQMD FOR APPROVAL AT LEAST 60 DAYS PRIOR TO START OF TESTS.

THE TEST SHALL INCLUDE THE FOLLOWING CONTAMINANTS AT THE SPECIFIED LOCATIONS OF FUEL INLET TO TURBINE, TURBINE EXHAUST PRIOR TO CATALYST/SCR, AND/OR FINAL STACK EXHAUST:

- A. METHANE (FUEL INLET)
- B. TOTAL NONMETHANE HYDROCARBONS (FUEL INLET, TURBINE AND STACK EXHAUSTS)

[RULE 1303 (a)(1)]

25. WHEN THE TURBINE IS FIRED ON NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, THE MAXIMUM QUANTITY OF NATURAL AND LANDFILL GAS USED SHALL NOT EXCEED 144 MILLION BTU'S PER HOUR FOR THE GAS TURBINE AND 90 MILLION BTU'S PER HOUR FOR THE DUCT BURNER BASED ON THE LOWER HEATING VALUES OF NATURAL AND LANDFILL GAS.
[RULE 1303 (a)(1)]
26. WHEN THE TURBINE IS FIRED ON FUEL OIL, THE MAXIMUM QUANTITY OF FUEL OIL FIRED SHALL NOT EXCEED 150 MILLION BTU'S PER HOUR, BASED ON THE LOWER HEATING VALUE OF FUEL OIL.
[RULE 1303 (a)(1)]
27. AMMONIA SHALL BE CONTINUOUSLY INJECTED WHENEVER THE CATALYST INLET TEMPERATURE REACHES 500 DEGREES F AND THE ELECTRIC OUTPUT OF THE TURBINE REACHES 4.5 MEGAWATTS, UNLESS OTHERWISE APPROVED IN WRITING BY THE AQMD.
[RULE 1303 (a)(1)]
28. THE OPERATOR SHALL KEEP THE FOLLOWING RECORDS:
- A. DATES AND TIMES OF START-UPS AND SHUT-DOWNS
 - B. QUANTITY OF NATURAL GAS, LANDFILL GAS AND FUEL OIL BURNED



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

- C. A DAILY LOG SHOWING THE REASON WHY NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS WAS NOT USED AND THE NUMBER OF HOURS DURING WHICH BACK-UP FUEL WAS USED.
- D. THE RESULTS FROM THE MONITORS REQUIRED BY PERMIT CONDITION NOS. 7,8,9, 10,11,12.

RECORDS OF THE COGENERATION SYSTEM SHALL BE MAINTAINED BY UCLA AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 1303 (a)(1), RULE 1302 (b)(2)]

- 29. FOR TESTING PURPOSES, THE GAS TURBINE SHALL NOT BE OPERATED WITH FUEL OIL FOR MORE THAN 8 HOURS PER DAY OR 100 HOURS PER YEAR.
[RULE 1303 (a)(1), RULE 1302 (b)(2)]
- 30. WATER INJECTION SHALL START WHENEVER THE ELECTRICAL OUTPUT OF THE GAS TURBINE REACHES 4.5 MEGAWATTS.
[RULE 1303 (a)(1)]
- 31. THE OPERATOR SHALL CONDUCT A SOURCE TEST IN ACCORDANCE WITH THE FOLLOWING SPECIFICATIONS:
 - A. THE TEST SHALL BE CONDUCTED AT LEAST ONCE DURING THE LIFE OF THE PERMIT.
 - B. THE TEST SHALL BE CONDUCTED TO DETERMINE THE PARTICULATE EMISSIONS USING EPA METHOD 5.2 MEASURED OVER A 60 MINUTE AVERAGING TIME PERIOD.
 - C. THE TEST SHALL BE CONDUCTED TO DEMONSTRATE COMPLIANCE WITH CONDITION NO. 17 AND 18 WHILE USING FUEL OIL.[RULE 1303 (b)(2)]

Periodic Monitoring:

- 32. THE OPERATOR SHALL CONDUCT AN INSPECTION FOR VISIBLE EMISSION FROM ALL STACKS AND OTHER EMISSION POINTS OF THIS EQUIPMENT ON AN ANNUAL BASIS WHENEVER THIS EQUIPMENT IS FIRED ON FUEL OIL FOR TRAINING/TESTING PURPOSE; AND AFTER EVERY 400 CUMULATIVE HOURS OF OPERATION ON DIESEL FUEL OR AFTER EVERY TWO MILLION GALLONS OF DIESEL FUEL COMBUSTED, TO BE COUNTED CUMULATIVELY OVER A FIVE YEAR PERIOD. THE INSPECTION SHALL BE CONDUCTED WHILE THE EQUIPMENT IS IN OPERATION AND DURING DAYLIGHT HOURS. IF ANY VISIBLE EMISSIONS (NOT INCLUDING CONDENSED WATER VAPOR) ARE DETECTED THAT LAST MORE THAN THREE MINUTES IN ANY ONE HOUR, THE OPERATOR SHALL EITHER:
 - A. TAKE CORRECTIVE ACTION(S) THAT ELIMINATES THE VISIBLE EMISSIONS WITHIN 24 HOURS AND REPORT THE VISIBLE EMISSIONS AS A POTENTIAL DEVIATION IN THE SAME FASHION AS DEVIATIONS ARE REQUIRED TO BE REPORTED IN SECTION K OF THIS PERMIT; OR
 - B. HAVE A CARB-CERTIFIED SMOKE READER DETERMINE COMPLIANCE WITH THE OPACITY STANDARD, USING EPA METHOD 9 OR THE PROCEDURES IN THE CARB MANUAL "VISIBLE EMISSION EVALUATION", WITHIN THREE BUSINESS DAYS AND REPORT ANY DEVIATIONS



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

TO AQMD.

IN ADDITION, THE OPERATOR SHALL KEEP THE RECORDS IN ACCORDANCE WITH THE RECORDKEEPING REQUIREMENTS IN SECTION K OF THIS PERMIT AND THE FOLLOWING RECORDS:

- A. STACK OR EMISSION POINT IDENTIFICATION;
 - B. DESCRIPTION OF ANY CORRECTIVE ACTIONS TAKEN TO ABATE VISIBLE EMISSIONS;
 - C. DATE AND TIME VISIBLE EMISSION WAS ABATED; AND
 - D. VISIBLE EMISSION OBSERVATION RECORD BY A CERTIFIED SMOKE READER.
- [RULE 3004 (a)(4)]

Emissions And Requirements:

33. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

NOx: 6 PPMV, RULE 1303(a)(1)
NOx: 9 PPMV, RULE 1134
CO 10 PPMV USING NATURAL GAS OR BLENDING NATURAL GAS/LANDFILL GAS, RULE 1303 (a)(1)
CO 13 PPMV USING FUEL OIL, RULE 1303 (a)(1)
CO: 2000 PPMV, RULE 407
H2S 150 PPMV, LANDFILL GAS, RULE 431.1
NH3 20 PPMV, RULE 1303 (a)(1)
PM: 0.1 GR/SCF, RULE 409
PM 11 LB/HR, 0.01 GR/SCF (FOR COMPLIANCE WITH RULE 475, EMISSIONS MAY EXCEED EITHER ONE OF THESE LIMITS BUT NOT BOTH AT THE SAME TIME), RULE 475
NOx 125 PPMV, GAS, RULE 476
NOX 225 PPMV, FUEL OIL, RULE 476
NOx: 210 PPM, 40 CFR60 SUBPART GG
SOx: 150 PPM, 40 CFR60 SUBPART GG



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. R-F00070
A/N 307860

Equipment Description:

COGENERATION SYSTEM NO. 2 CONSISTING OF:

1. GAS TURBINE NO. 2, GENERAL ELECTRIC, MODEL LM1600, RATED AT 140.34 MMBTU/HR, NATURAL GAS, BLENDED NATURAL AND LANDFILL GAS, OR FUEL OIL FIRED, WITH A WATER INJECTION SYSTEM, DRIVING A 14.4 MW ELECTRICAL GENERATOR.
2. WASTE HEAT BOILER NO. 2, DELTAK CORPORATION, PRODUCING 117,000 LB/HR OF SUPERHEATED STEAM AT 660 PSIG AND 41,200 LB/HR OF SATURATED STEAM AT 15 PSIG, WITH AN 86 MMBTU/HR NATURAL GAS OR BLENDED NATURAL GAS AND LANDFILL GAS FIRED DUCT BURNER, SUPERHEATER, EVAPORATOR, ECONOMIZER, FEEDWATER PREHEATER, AND A CONTINUOUS EMISSIONS MONITOR.
3. THREE (3) NATURAL GAS COMPRESSORS, KCI, INC., 350 HP EACH, AND ONE (1) LANDFILL GAS COMPRESSOR, KCI, INC., 1250 HP (COMMON TO COGENERATION SYSTEM NO. 1)
4. ONE STEAM TURBINE, SHIN NIPPON MACHINERY CO, LTD., 14.5 MW, WITH A WATER COOLED CONDENSER AND COOLING TOWER (COMMON TO COGENERATION SYSTEM NO. 1)

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED AND MAINTAINED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
4. THIS EQUIPMENT SHALL NOT BE OPERATED UNLESS IT IS VENTED TO AIR POLLUTION CONTROL EQUIPMENT WHICH IS IN FULL USE AND WHICH HAS A VALID PERMIT ISSUED BY THE AQMD.
[RULE 1303 (a)(1), RULE 1134]
5. WATER INJECTION SHALL BE USED DURING OPERATION OF THE GAS TURBINE EXCEPT DURING START-UP AND SHUT-DOWN.
[RULE 1303 (a)(1), RULE 1134]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

6. THE DUCT BURNER SHALL ONLY BE FIRED WITH NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, AND SHALL NOT BE OPERATED WHEN THE GAS TURBINE IS FIRED WITH FUEL OIL, EXCEPT DURING TESTING.
[RULE 1303 (a)(1), RULE 1134]
7. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MONITOR AND RECORD THE FUEL CONSUMPTION AND THE MASS RATIO OF WATER TO FUEL BEING FIRED IN THE TURBINE. THIS SYSTEM SHALL BE ACCURATE TO WITHIN PLUS OR MINUS 5.0 PERCENT.
[RULE 1303 (a)(1), RULE 1134]
8. THE DUCT BURNER SHALL BE EQUIPPED WITH A FLOW MONITORING DEVICE WHICH SHALL MEASURE AND RECORD THE FUEL CONSUMPTION (IN MILLION BTU'S PER HOUR) IN THE BURNER.
[RULE 1303 (a)(1)]
9. THE GAS TURBINE SHALL BE EQUIPPED WITH A FLOW MONITORING DEVICE WHICH SHALL MEASURE AND RECORD EACH FUEL (NATURAL GAS, LANDFILL GAS, AND FUEL OIL) CONSUMPTION (IN MILLION BTU'S PER HOUR).
[RULE 1303 (a)(1)]
10. A CONTINUOUS MONITORING AND RECORDING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE AND RECORD THE MOLE RATIO OF INJECTED AMMONIA (NH₃) TO SCR INLET NOX. THIS SYSTEM SHALL BE ACCURATE TO WITHIN PLUS OR MINUS 5.0 PERCENT.
[RULE 1303 (a)(1)]
11. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE, OVER A FIFTEEN CONSECUTIVE MINUTE AVERAGE TIME PERIOD, AND RECORD THE WASTE HEAT RECOVERY BOILER EXHAUST STACK FOR NOX, CO AND O₂ CONCENTRATIONS, ON A DRY BASIS. THE SYSTEM SHALL ALSO CONVERT THE ACTUAL NOX AND CO CONCENTRATIONS TO A CORRECTED CONCENTRATION AT 15 PERCENT OXYGEN, ON A DRY BASIS, AND CONTINUOUSLY RECORD THESE CORRECTED STACK NOX, CO AND O₂ CONCENTRATIONS. IN ADDITION, THE SYSTEM SHALL MONITOR AND RECORD THE DAILY NOX AND CO EMISSIONS IN POUNDS PER DAY FROM THE COGENERATION SYSTEM/WASTE HEAT BOILER/EXHAUST STACK. THIS MONITORING SYSTEM SHALL BE CERTIFIED TO COMPLY WITH THE REQUIREMENTS OF RULE 218.
[RULE 1134, RULE 1303 (a)(1), RULE 1303 (b)(2), RULE 218]
12. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE AND RECORD THE VOLUMETRIC FLOW RATE IN THE EXHAUST STACK. THIS MONITORING SYSTEM SHALL COMPLY WITH THE REQUIREMENTS OF RULE 218.
[RULE 1303 (a)(1), RULE 1303 (b)(2), RULE 218]
13. THE GAS TURBINE SHALL ONLY FIRE NATURAL GAS OR A BLEND OF LANDFILL GAS AND NATURAL GAS, EXCEPT DURING TESTING, UNLESS NATURAL GAS IS UNAVAILABLE.
[RULE 1303 (a)(1)]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

14. ONLY ONE OF THE GAS TURBINES SHALL BE OPERATED SIMULTANEOUSLY WITH THE AUXILIARY BOILER.
[RULE 1303 (b)(2)]

15. WHEN THE TURBINE IS FIRING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER DAY LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
31	121	2	124	30

[RULE 1303 (b)(2)]

16. WHEN THE TURBINE IS FIRING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER HOUR LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
1.3	5.0	0.1	5.2	1.25

[RULE 1303 (b)(2)]

17. WHEN THE TURBINE IS FIRING FUEL OIL, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER DAY LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
26	89	118	98	125

[RULE 1303 (b)(2)]

18. WHEN THE TURBINE IS FIRING FUEL OIL, EMISSIONS FROM THE WASTE HEAT BOILER EXHAUST, EXCEPT DURING START-UPS AND SHUT-DOWNS, SHALL NOT EXCEED THE FOLLOWING TOTAL POUND PER HOUR LIMITS:

ROG(AS CH ₄)	NOX	SOX	CO	PM
1.1	3.7	4.9	4.1	5.2

[RULE 1303 (b)(2)]

19. EMISSIONS OF OXIDES OF NITROGEN, AS NO₂, FROM THE WASTE HEAT BOILER EXHAUST SHALL NOT EXCEED 6 PPMV, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]

20. EMISSIONS OF CARBON MONOXIDE (CO) FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 10 PPMV DURING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS FIRING AND 13 PPMV DURING FUEL OIL FIRING, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

21. EMISSIONS OF AMMONIA (NH₃) FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 20 PPMV, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]
22. ALL CONCENTRATIONS OF GASEOUS EMISSIONS SHALL BE EXPRESSED IN PARTS PER MILLION BY VOLUME CORRECTED TO 15% OXYGEN, DRY, AND SHALL BE MEASURED OVER FOUR CONSECUTIVE FIFTEEN MINUTE AVERAGE TIME PERIODS IN ANY ONE HOUR.
[RULE 1303 (a)(1)]
23. SAMPLING PORTS SHALL BE MAINTAINED IN THE GAS TURBINE EXHAUST DUCT AND WASTE HEAT BOILER EXHAUST DUCT 8-10 DUCT DIAMETERS DOWNSTREAM AND TWO (2) EQUIVALENT DUCT DIAMETERS UPSTREAM OF ANY FLOW DISTURBANCE AND SHALL CONSIST OF TWO 4-INCH WELDED NIPPLES WITH CAPS. OWNER/OPERATOR SHALL PROVIDE ADEQUATE AND SAFE ACCESS TO THE TEST PORTS. AN EQUIVALENT METHOD SHALL BE USED UPON PRIOR APPROVAL BY THE AQMD.
[RULE 217]
24. WITHIN 30 DAYS OF THE ANNIVERSARY OF THE INITIAL PERFORMANCE TEST, UNLESS OTHERWISE APPROVED BY THE AQMD, UCLA SHALL CONDUCT ANNUAL PERFORMANCE TESTS IN ACCORDANCE WITH AQMD TEST PROCEDURES AND FURNISH THE AQMD WRITTEN RESULTS OF SUCH PERFORMANCE TESTS WITHIN 45 DAYS AFTER TESTING. ALL SOURCE TESTING PROCEDURES AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE AQMD FOR APPROVAL AT LEAST 60 DAYS PRIOR TO START OF TESTS.

THE TEST SHALL INCLUDE THE FOLLOWING CONTAMINANTS AT THE SPECIFIED LOCATIONS OF FUEL INLET TO TURBINE, TURBINE EXHAUST PRIOR TO CATALYST/SCR, AND/OR FINAL STACK EXHAUST:

- A. METHANE (FUEL INLET)
- B. TOTAL NONMETHANE HYDROCARBONS (FUEL INLET, TURBINE AND STACK EXHAUSTS)

[RULE 1303 (a)(1)]

25. WHEN THE TURBINE IS FIRED ON NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS, THE MAXIMUM QUANTITY OF NATURAL AND LANDFILL GAS USED SHALL NOT EXCEED 144 MILLION BTU'S PER HOUR FOR THE GAS TURBINE AND 90 MILLION BTU'S PER HOUR FOR THE DUCT BURNER BASED ON THE LOWER HEATING VALUES OF NATURAL AND LANDFILL GAS.
[RULE 1303 (a)(1)]
26. WHEN THE TURBINE IS FIRED ON FUEL OIL, THE MAXIMUM QUANTITY OF FUEL OIL FIRED SHALL NOT EXCEED 150 MILLION BTU'S PER HOUR, BASED ON THE LOWER HEATING VALUE OF FUEL OIL.
[RULE 1303 (a)(1)]
27. AMMONIA SHALL BE CONTINUOUSLY INJECTED WHENEVER THE CATALYST INLET TEMPERATURE REACHES 500 DEGREES F AND THE ELECTRIC OUTPUT OF THE TURBINE REACHES 4.5 MEGAWATTS, UNLESS OTHERWISE APPROVED IN WRITING BY THE AQMD.
[RULE 1303 (a)(1)]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

28. THE OPERATOR SHALL KEEP THE FOLLOWING RECORDS:

- A. DATES AND TIMES OF START-UPS AND SHUT-DOWNS
- B. QUANTITY OF NATURAL GAS, LANDFILL GAS AND FUEL OIL BURNED
- C. A DAILY LOG SHOWING THE REASON WHY NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS WAS NOT USED AND THE NUMBER OF HOURS DURING WHICH BACK-UP FUEL WAS USED.
- D. THE RESULTS FROM THE MONITORS REQUIRED BY PERMIT CONDITION NOS. 7,8,9, 10,11,12.

RECORDS OF THE COGENERATION SYSTEM SHALL BE MAINTAINED BY UCLA AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 1303 (a)(1), RULE 1303 (b)(2)]

29. FOR TESTING PURPOSES, THE GAS TURBINE SHALL NOT BE OPERATED WITH FUEL OIL FOR MORE THAN 8 HOURS PER DAY OR 100 HOURS PER YEAR.
[RULE 1303 (a)(1), RULE 1303 (b)(2)]

30. WATER INJECTION SHALL START WHENEVER THE ELECTRICAL OUTPUT OF THE GAS TURBINE REACHES 4.5 MEGAWATTS.
[RULE 1303 (a)(1)]

31. THE OPERATOR SHALL CONDUCT A SOURCE TEST IN ACCORDANCE WITH THE FOLLOWING SPECIFICATIONS:

- A. THE TEST SHALL BE CONDUCTED AT LEAST ONCE DURING THE LIFE OF THE PERMIT.
 - B. THE TEST SHALL BE CONDUCTED TO DETERMINE THE PARTICULATE EMISSIONS USING EPA METHOD 5.2 MEASURED OVER A 60 MINUTE AVERAGING TIME PERIOD.
 - C. THE TEST SHALL BE CONDUCTED TO DEMONSTRATE COMPLIANCE WITH CONDITION NO. 17 AND 18 WHILE USING FUEL OIL.
- [RULE 1303 (b)(2)]

Periodic Monitoring:

32. THE OPERATOR SHALL CONDUCT AN INSPECTION FOR VISIBLE EMISSION FROM ALL STACKS AND OTHER EMISSION POINTS OF THIS EQUIPMENT ON AN ANNUAL BASIS WHENEVER THIS EQUIPMENT IS FIRED ON FUEL OIL FOR TRAINING/TESTING PURPOSE; AND AFTER EVERY 400 CUMULATIVE HOURS OF OPERATION ON DIESEL FUEL OR AFTER EVERY TWO MILLION GALLONS OF DIESEL FUEL COMBUSTED, TO BE COUNTED CUMULATIVELY OVER A FIVE YEAR PERIOD. THE INSPECTION SHALL BE CONDUCTED WHILE THE EQUIPMENT IS IN OPERATION AND DURING DAYLIGHT HOURS. IF ANY VISIBLE EMISSIONS (NOT INCLUDING CONDENSED WATER VAPOR) ARE DETECTED THAT LAST MORE THAN THREE MINUTES IN ANY ONE HOUR, THE OPERATOR SHALL EITHER:

- A. TAKE CORRECTIVE ACTION(S) THAT ELIMINATES THE VISIBLE EMISSIONS WITHIN 24 HOURS AND REPORT THE VISIBLE EMISSIONS AS A POTENTIAL DEVIATION IN THE SAME FASHION AS DEVIATIONS ARE REQUIRED TO BE REPORTED IN SECTION K OF



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

THIS PERMIT; OR

- B. AVE A CARB-CERTIFIED SMOKE READER DETERMINE COMPLIANCE WITH THE OPACITY STANDARD, USING EPA METHOD 9 OR THE PROCEDURES IN THE CARB MANUAL "VISIBLE EMISSION EVALUATION", WITHIN THREE BUSINESS DAYS AND REPORT ANY DEVIATIONS TO AQMD.

IN ADDITION, THE OPERATOR SHALL KEEP THE RECORDS IN ACCORDANCE WITH THE RECORDKEEPING REQUIREMENTS IN SECTION K OF THIS PERMIT AND THE FOLLOWING RECORDS:

- A. STACK OR EMISSION POINT IDENTIFICATION;
B. DESCRIPTION OF ANY CORRECTIVE ACTIONS TAKEN TO ABATE VISIBLE EMISSIONS;
C. DATE AND TIME VISIBLE EMISSION WAS ABATED; AND
D. VISIBLE EMISSION OBSERVATION RECORD BY A CERTIFIED SMOKE READER.
[RULE 3004 (a)(4)]

Emissions And Requirements:

33. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

NOx: 6 PPMV, RULE 1303(a)(1)
NOx: 9 PPMV, RULE 1134
CO 10 PPMV USING NATURAL GAS OR BLENDING NATURAL GAS/LANDFILL GAS, RULE 1303 (a)(1)
CO 13 PPMV USING FUEL OIL, RULE 1303 (a)(1)
CO: 2000 PPMV, RULE 407
H2S 150 PPMV, LANDFILL GAS, RULE 431.1
NH3 20 PPMV, RULE 1303 (a)(1)
PM: 0.1 GR/SCF, RULE 409
PM 11 LB/HR, 0.01 GR/SCF (FOR COMPLIANCE WITH RULE 475, EMISSIONS MAY EXCEED EITHER ONE OF THESE LIMITS BUT NOT BOTH AT THE SAME TIME), RULE 475
NOx 125 PPMV, GAS, RULE 476
NOX 225 PPMV, FUEL OIL, RULE 476
NOx: 210 PPM, 40 CFR60 SUBPART GG
SOx: 150 PPM, 40 CFR60 SUBPART GG



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F2279
A/N 318723

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, 6 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. 3306 ATAAC, 377 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED IN SRL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F4805
A/N 319009

Equipment Description:

INTERNAL COMBUSTION ENGINE, MAGNETEK, MODEL NO. RSD1875, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, SERIAL NO. BJ08B691, (PHYSICAL PLANT BUILDING), 6 CYLINDERS, NATURALLY ASPIRATED, 201 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
4. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
5. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. F4808
A/N 319012**

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL/PERKINS, MODEL NO. 80DS60, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, SERIAL NO. 353847, (UNIX BUILDING), 6 CYLINDERS, TURBOCHARGED, 107 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
4. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
5. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F4807
A/N 319015

Equipment Description:

INTERNAL COMBUSTION ENGINE, JOHN DEERE, MODEL NO. 6076AF011, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, SERIAL NO. 189926-71, (POWELL LIBRARY), 6 CYLINDERS, TURBOCHARGED, 240 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
4. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
5. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F4681
A/N 319016

Equipment Description:

INTERNAL COMBUSTION ENGINE, KOMATSU, MODEL NO. 671T, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, SERIAL NO. 54217, (SOUTHERN REGIONAL LIBRARY), 6 CYLINDERS, TURBOCHARGED, 168 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F5269
A/N 319017

Equipment Description:

INTERNAL COMBUSTION ENGINE, JOHN DEERE, MODEL NO. 6414T, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, GENERATOR MODEL NO. 1215P, SERIAL NO. T0641472009486414TF001, (PAULEY PAVILLION), 6 CYLINDERS, TURBOCHARGED, 135 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
4. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
5. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F4806
A/N 319020

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT 40, MODEL NO. SPECTRUM 125, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, SERIAL NO. 8828108, (PARKING STRUCTURE NO. 8), 4 CYLINDERS, TURBOCHARGED, 168 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)]
4. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
5. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F5268
A/N 319021

Equipment Description:

INTERNAL COMBUSTION ENGINE, WHITE, MODEL NO. D4800 TX198, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, SERIAL NO. 4019497, (LA TENNIS CENTER), 6 CYLINDERS, TURBOCHARGED, 135 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F5266
A/N 319025

Equipment Description:

INTERNAL COMBUSTION ENGINE, WHITE, MODEL NO. DS400T, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, SERIAL NO. YE3450258.D34000TX254, 6 CYLINDERS, TURBOCHARGED, 100 BHP (LOCATED AT BUNCH).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F3116
A/N 320232

Equipment Description:

INTERNAL COMBUSTION ENGINE, GENERAC, 6 CYLINDERS, TURBOCHARGED, MODEL NO. 133DT (240 BHP), 240 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT TIVERTON).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F4983
A/N 323826

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, 6 CYLINDERS, TURBOCHARGED, MODEL NO. 8063-7305 (6V-92T), 370 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 3 DEGREES RETARDED RELATIVE TO PRODUCTION TIMING AS ESTABLISHED BY DETROIT DIESEL IN PRODUCT ANNOUNCEMENT 'INJECTION TIMING RETARD INSTRUCTIONS FOR CONFORMANCE WITH THE SCAQMD'S GENERAL PERMIT REGISTRATION PROGRAM, 6V-92T GENERATOR SET ENGINE MODEL 9063-7305'.
[RULE 1303 (a)(1)]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F5492
A/N 324434

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, 6 CYLINDERS, TURBOCHARGED, MODEL NO. 8063-7305 (6V-92T), 370 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT LAW).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 3 DEGREES RETARDED RELATIVE TO PRODUCTION TIMING AS ESTABLISHED BY DETROIT DIESEL IN PRODUCT ANNOUNCEMENT 'INJECTION TIMING RETARD INSTRUCTIONS FOR CONFORMANCE WITH THE SCAQMD'S GENERAL PERMIT REGISTRATION PROGRAM, 6V-92T GENERATOR SET ENGINE MODEL 9063-7305'.
[RULE 1303 (a)(1)]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F37549
A/N 324436

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS, MODEL MT855-04, SERIAL NO.30318768, DIESEL-FUELED, 6 CYLINDERS, TURBOCHARGED, RATED AT 375 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F37540
A/N 324438

Equipment Description:

INTERNAL COMBUSTION ENGINE, KOMATSU, MODEL 56D105-1, SERIAL NO.95843, DIESEL-FUELED, 6 CYLINDERS, TURBOCHARGED, RATED AT 154.8 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)]
8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F37551
A/N 324439

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL 91637316, SERIAL NO. 6A00598, DIESEL-FUELED, 16 CYLINDERS, TURBOCHARGED, RATED AT 2514 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)]
8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F9960
A/N 332786

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS, MODEL NO. KTA50-G3, SERIAL # E970638543, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, TURBOCHARGED, AFTERCOOLED, 16 CYLINDERS, 1,850 BHP (LOCATED AT GANDA).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F11549
A/N 336111

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, 12 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. 3412 DITTA (500 KW), SERIAL NO. 81Z20682, RATED AT 746 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT STRB).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO PRODUCTION TIMING AS ESTABLISHED BY CATERPILLAR IN PRODUCT NEWS BULLETIN '3412 DITTA 500 KW CALIFORNIA CONFIGURATION'.
[RULE 1303 (a)]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:
- PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F17312
A/N 346215

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, 6 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. 3406 DITA (350 KW), SERIAL NO. 4ZR03724, RATED AT 519 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT PARKING STRUCTURE #4).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F23691
A/N 363084

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, 12 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. 3412 DITTA (500 KW), RATED AT 746 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT UCPD).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO PRODUCTION TIMING AS ESTABLISHED BY CATERPILLAR IN PRODUCT NEWS BULLETIN '3412 DITTA 500 KW CALIFORNIA CONFIGURATION'.
[RULE 1303 (a)]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F23692
A/N 363085

Equipment Description:

INTERNAL COMBUSTION ENGINE, NAVISTAR INTERNATIONAL, 6 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. S-40 7.6LTA, 250 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT LS).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F36980
A/N 377360

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL 6063-TK35, DIESEL-FUELED, SIX CYLINDERS, TURBOCHARGED AND AFTERCOOLED, RATED AT 550 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT DENEVE).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F37887
A/N 378897

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, MODEL 3306 ATTACC, DIESEL-FUELED, 6 CYLINDERS, TURBOCHARGED AND AFTERCOOLED, RATED AT 377 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F38570
A/N 378957

Equipment Description:

INTERNAL COMBUSTION ENGINE, GENERAC, MODEL 13.3 DTA, SERIAL NO. 993921, DIESEL-FUELED, 6 CYLINDERS, TURBOCHARGED AND AFTERCOOLED, RATED AT 440 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT HEDRICK HALL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F38571
A/N 378959

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, MODEL 3412, SERIAL NO. 81Z0797, DIESEL-FUELED, 12 CYLINDERS, TURBOCHARGED, RATED AT 724 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT SPROUL HALL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F38572
A/N 378960

Equipment Description:

INTERNAL COMBUSTION ENGINE, GENERAC, MODEL 133DT, SERIAL NO. 889692, DIESEL-FUELED, TURBOCHARGED, RATED AT 320 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT DYKSTRA HALL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F37922
A/N 383299

Equipment Description:

INTERNAL COMBUSTION ENGINE, PERKINS, MODEL 1006-6GT, DIESEL-FUELED, 6 CYLINDERS, TURBOCHARGED, RATED AT 166 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT FRANZ HALL).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F39010
A/N 383303

Equipment Description:

INTERNAL COMBUSTION ENGINE, PERKINS, MODEL 4.236T00, SERIAL NO. U708505A, DIESEL-FUELED, 4 CYLINDERS, FOUR CYCLE, TURBOCHARGED, RATED AT 94 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT MATH SCIENCES).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN 4.5 HOURS IN ANY ONE DAY.
[RULE 1303 (a)]
5. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
6. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
7. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1303 (a), RULE 1304 (a)(4), RULE 1470]
8. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)]
9. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1470]

10. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
11. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

12. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. 49789
A/N 398478

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS, 6 CYLINDERS, TURBOCHARGED, AFTERCOOLED, MODEL NO. N14-G2 (399 KW), SERIAL NO. 12027427, 535 BHP, DIESEL-FUELED, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. A TIMER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]
6. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
7. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
8. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F52213
A/N 400674

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL NO. 6063-HK35, SERIAL NO. 343692, DIESEL-FUELED, 6-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 635 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F52214
A/N 400675

Equipment Description:

INTERNAL COMBUSTION ENGINE, JOHN DEERE, MODEL NO. 6081T, SERIAL NO. RG6081T139870, DIESEL-FUELED, 6-CYLINDER, TURBOCHARGED, 260 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F52215
A/N 400702

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS, MODEL NO. 6CTAA8.3-G3, DIESEL-FUELED, 6-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 317 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F56614
A/N 408454

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, MODEL 3516B-DITA, DIESEL-FUELED, TURBOCHARGED AND AFTERCOOLED, 16-CYLINDER, 2847 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT SRB1 BUILDING).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F58406
A/N 409647

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL NO. R123-7K35 (12V-2000), DIESEL-FUELED, 12-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 910 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F58435
A/N 409648

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL NO. 6063-TK35, DIESEL-FUELED, 6-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 490 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F58436
A/N 409649

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL NO. 6063-TK35, DIESEL-FUELED, 6-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 490 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 20 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304 (a)(4), RULE 1470]
5. IN ADDITION TO MAINTENANCE AND TESTING OF THIS ENGINE, THIS ENGINE SHALL ONLY OPERATE DURING EMERGENCIES RESULTING IN AN INTERRUPTION OF SERVICE OF THE PRIMARY POWER SUPPLY OR DURING STAGE II OR III ELECTRICAL EMERGENCY DECLARED BY THE CALIFORNIA INDEPENDENT SYSTEM OPERATOR.
[RULE 1304 (a)(4)]
6. AN ENGINE OPERATING LOG LISTING THE DATE OF OPERATION, THE ELAPSED TIME, IN HOURS, AND THE REASON FOR OPERATION SHALL BE KEPT AND MAINTAINED ON FILE FOR A MINIMUM OF FIVE YEARS AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST.
[RULE 1304 (a)(4), RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F62618
A/N 415044

Equipment Description:

INTERNAL COMBUSTION ENGINE, CUMMINS, MODEL NO. 6CTA8.3-G, SERIAL NO. 45726455, DIESEL-FUELED, TURBOCHARGED AND AFTERCOOLED, 277 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT BRAIN MAPPING BLDG.).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT OPERATE MORE THAN 200 HOURS IN ANY ONE YEAR, WHICH INCLUDES NO MORE THAN 20 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING PURPOSES.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG SHALL BE KEPT AND MAINTAINED ON FILE TO RECORD WHEN THIS ENGINE IS STARTED MANUALLY. THE LOG SHALL LIST THE DATE OF OPERATION, THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION, AND THE REASON FOR OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304 (a)(4), RULE 1470]
6. THE OPERATION OF ENGINE BEYOND THE 20 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE ELECTRICAL GRID OPERATOR OR ELECTRIC UTILITY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECTED TO THE ROTATING OUTAGE.
[RULE 1304 (a)(4)]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F81771
A/N 406662

Equipment Description:

(located at the Energy Systems Facility/South Campus Central Chiller Plant)

AIR POLLUTION CONTROL SYSTEM NO. 1, SERVING COGENERATION SYSTEM NO. 1, CONSISTING OF:

1. REACTOR, NOX SELECTIVE CATALYTIC REDUCTION (SCR), FOSTER WHEELER ENERGY CORP., 8' 5-1/2" W. X 2' 4-3/8" L. X 25' 3-1/4" H., WITH AN AMMONIA INJECTION SYSTEM, AND A UREA TO AMMONIA GENERATION SYSTEM (COMMON TO AIR POLLUTION CONTROL SYSTEM NO. 2) CONSISTING OF:
 - A. HYDROLYSIS REACTOR, UREA TO AMMONIA CONVERSION SYSTEM.
 - B. STORAGE TANK, REACTOR FEED TANK, FIXED ROOF, UREA 40% SOLUTION, 12,000-GALLON CAPACITY, 12' 0" DIA. X 15' 6" H.
2. REACTOR, CO OXIDATION CATALYST, ENGELHARD, HONEY COMB TYPE, 10' 0" W. X 34' 0" H.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED AND MAINTAINED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
4. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE AND RECORD THE MOLE RATIO OF INJECTED AMMONIA (NH₃) TO SCR INLET NOX. THIS SYSTEM SHALL BE ACCURATE TO WITHIN PLUS OR MINUS 5.0 PERCENT (+/- 5.0%).
[RULE 218]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

5. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE, OVER A FIFTEEN CONSECUTIVE MINUTE AVERAGE TIME PERIOD, AND RECORD THE WASTE HEAT RECOVERY BOILER EXHAUST STACK FOR NOX, CO AND O₂ CONCENTRATIONS, ON A DRY BASIS. THE SYSTEM SHALL ALSO CONVERT THE ACTUAL NOX AND CO CONCENTRATIONS TO A CORRECTED CONCENTRATION AT 15 PERCENT OXYGEN, ON A DRY BASIS, AND CONTINUOUSLY RECORD THESE CORRECTED STACK NOX, CO AND O₂ CONCENTRATIONS. IN ADDITION, THE SYSTEM SHALL MONITOR AND RECORD THE DAILY NOX AND CO EMISSIONS IN POUNDS PER DAY FROM THE COGENERATION SYSTEM/WASTE HEAT BOILER/EXHAUST STACK. THIS MONITORING SYSTEM SHALL COMPLY WITH THE REQUIREMENTS OF RULE 218.
[RULE 1134, RULE 1303 (a)(1), RULE 218]
6. EMISSIONS OF OXIDES OF NITROGEN, AS NO₂, FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 6 PPMV, CALCULATED DRY, AT 15 % O₂, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]
7. EMISSIONS OF CARBON MONOXIDE (CO) FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 10 PPMV DURING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS FIRING AND 13 PPMV DURING FUEL OIL FIRING, CALCULATED DRY, AT 15 % OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]
8. EMISSIONS OF AMMONIA (NH₃) FROM THE WASTE HEAT BOILER EXHAUST SHALL NOT EXCEED 20 PPMV, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START- UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]
9. ALL CONCENTRATIONS OF GASEOUS EMISSIONS SHALL BE EXPRESSED IN PARTS PER MILLION BY VOLUME CORRECTED TO 15% OXYGEN, DRY, AND SHALL BE MEASURED OVER FOUR CONSECUTIVE FIFTEEN MINUTE AVERAGE TIME PERIODS IN ANY HOUR.
[RULE 1134, RULE 1303 (a)(1)]
10. SAMPLING PORTS SHALL BE PROVIDED IN THE GAS TURBINE EXHAUST DUCT AND WASTE HEAT BOILER EXHAUST DUCT 8-10 DUCT DIAMETERS DOWNSTREAM AND TWO (2) EQUIVALENT DUCT DIAMETERS UPSTREAM OF ANY FLOW DISTURBANCE AND SHALL CONSIST OF TWO 4-INCH WELDED NIPPLES WITH CAPS. OWNER/OPERATOR SHALL PROVIDE ADEQUATE AND SAFE ACCESS TO THE TEST PORTS. AN EQUIVALENT METHOD SHALL BE USED UPON PRIOR APPROVAL BY THE SCAQMD.
[RULE 217]
11. UCLA SHALL CONDUCT ANNUAL PERFORMANCE TESTS IN ACCORDANCE WITH SCAQMD TEST PROCEDURES AND FURNISH THE SCAQMD WRITTEN RESULTS OF SUCH PERFORMANCE TESTS WITHIN 45 DAYS AFTER TESTING. ALL SOURCE TESTING PROCEDURES AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE SCAQMD FOR APPROVAL AT LEAST 60 DAYS PRIOR TO START OF TESTS.

THE TEST SHALL INCLUDE THE FOLLOWING CONTAMINANTS AT THE SPECIFIED LOCATIONS OF FUEL INLET TO TURBINE, TURBINE EXHAUST PRIOR TO CATALYST/SCR, AND/OR FINAL STACK EXHAUST WHILE FUELED WITH BLENDED NATURAL AND LANDFILL GAS:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

- A. METHANE (FUEL INLET)
 - B. TOTAL NONMETHANE HYDROCARBONS (FUEL INLET, STACK)
 - C. AMMONIA (STACK EXHAUST)
- [RULE 1134, RULE 1303 (a)(1), RULE 1303 (b)(2)]

12. AMMONIA SHALL BE CONTINUOUSLY INJECTED WHENEVER THE CATALYST INLET TEMPERATURE REACHES 500 DEGREES F AND THE ELECTRIC OUTPUT OF THE TURBINE REACHES 4.5 MEGAWATTS, UNLESS OTHERWISE APPROVED IN WRITING BY THE SCAQMD.
[RULE 1303 (a)(1)]
13. THE OPERATOR SHALL KEEP THE FOLLOWING RECORDS:
- A. DATES AND TIMES OF START-UPS AND SHUT-DOWNS.
 - B. QUANTITY OF NATURAL GAS, LANDFILL GAS AND FUEL OIL BURNED.
 - C. REASONS WHY NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS WAS NOT USED AND THE NUMBER OF HOURS DURING WHICH BACK-UP FUEL WAS USED.
 - D. RESULTS FROM THE MONITORS REQUIRED BY PERMIT CONDITION NOS. 4 AND 5.

RECORDS OF THE COGENERATION SYSTEM SHALL BE MAINTAINED BY UCLA AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 1134, RULE 1303 (a)(1), RULE 1303 (b)(2)]

Periodic Monitoring:

14. THE OPERATOR SHALL INSTALL AND MAINTAIN A TEMPERATURE GAUGE TO ACCURATELY INDICATE THE TEMPERATURE AT THE INLET OF THE CATALYST. THE OPERATOR SHALL ALSO INSTALL AND MAINTAIN A DEVICE TO CONTINUOUSLY RECORD THE PARAMETER BEING MEASURED.
[RULE 3004 (a)(4)]

Emissions And Requirements:

15. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

NH3: 20 PPMV, RULE 1303 (a)(1)



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F81770
A/N 406663

Equipment Description:

(located at the Energy Systems Facility/South Campus Central Chiller Plant)

AIR POLLUTION CONTROL SYSTEM NO. 2, SERVING COGENERATION SYSTEM NO. 2, CONSISTING OF:

1. REACTOR, NOX SELECTIVE CATALYTIC REDUCTION (SCR), FOSTER WHEELER ENERGY CORP., 8' 5-1/2" W. X 2' 4-3/8" L. X 25' 3-1/4" H., WITH AN AMMONIA INJECTION SYSTEM, AND A UREA TO AMMONIA GENERATION SYSTEM (COMMON TO AIR POLLUTION CONTROL SYSTEM NO. 1) CONSISTING OF:
 - A. HYDROLYSIS REACTOR, UREA TO AMMONIA CONVERSION SYSTEM.
 - B. STORAGE TANK, REACTOR FEED TANK, FIXED ROOF, UREA 40% SOLUTION, 12,000-GALLON CAPACITY, 12' 0" DIA. X 15' 6" H.
2. REACTOR, CO OXIDATION CATALYST, ENGELHARD, HONEY COMB TYPE, 10' 0" W. X 34' 0" H.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS EQUIPMENT SHALL BE OPERATED AND MAINTAINED BY PERSONNEL PROPERLY TRAINED IN ITS OPERATION.
[RULE 204]
4. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE AND RECORD THE MOLE RATIO OF INJECTED AMMONIA (NH₃) TO SCR INLET NOX. THIS SYSTEM SHALL BE ACCURATE TO WITHIN PLUS OR MINUS 5.0 PERCENT (+/- 5.0%).
[RULE 218]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

5. A CONTINUOUS MONITORING SYSTEM SHALL BE MAINTAINED AND OPERATED TO MEASURE, OVER A FIFTEEN CONSECUTIVE MINUTE AVERAGE TIME PERIOD, AND RECORD THE WASTE HEAT RECOVERY BOILER EXHAUST STACK FOR NOX, CO AND O₂ CONCENTRATIONS, ON A DRY BASIS. THE SYSTEM SHALL ALSO CONVERT THE ACTUAL NOX AND CO CONCENTRATIONS TO A CORRECTED CONCENTRATION AT 15 PERCENT OXYGEN, ON A DRY BASIS, AND CONTINUOUSLY RECORD THESE CORRECTED STACK NOX, CO AND O₂ CONCENTRATIONS. IN ADDITION, THE SYSTEM SHALL MONITOR AND RECORD THE DAILY NOX AND CO EMISSIONS IN POUNDS PER DAY FROM THE COGENERATION SYSTEM/WASTE HEAT BOILER/EXHAUST STACK. THIS MONITORING SYSTEM SHALL COMPLY WITH THE REQUIREMENTS OF RULE 218.
[RULE 1134, RULE 1303 (a)(1), RULE 218]
6. EMISSIONS OF OXIDES OF NITROGEN, AS NO₂, FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 6 PPMV, CALCULATED DRY, AT 15 % O₂, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]
7. EMISSIONS OF CARBON MONOXIDE (CO) FROM THE WASTE HEAT BOILER EXHAUST STACK SHALL NOT EXCEED 10 PPMV DURING NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS FIRING AND 13 PPMV DURING FUEL OIL FIRING, CALCULATED DRY, AT 15 % OXYGEN, EXCEPT DURING START-UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]
8. EMISSIONS OF AMMONIA (NH₃) FROM THE WASTE HEAT BOILER EXHAUST SHALL NOT EXCEED 20 PPMV, CALCULATED DRY, AT 15% OXYGEN, EXCEPT DURING START- UP AND SHUT-DOWN OPERATIONS.
[RULE 1303 (a)(1)]
9. ALL CONCENTRATIONS OF GASEOUS EMISSIONS SHALL BE EXPRESSED IN PARTS PER MILLION BY VOLUME CORRECTED TO 15% OXYGEN, DRY, AND SHALL BE MEASURED OVER FOUR CONSECUTIVE FIFTEEN MINUTE AVERAGE TIME PERIODS IN ANY HOUR.
[RULE 1134, RULE 1303 (a)(1)]
10. SAMPLING PORTS SHALL BE PROVIDED IN THE GAS TURBINE EXHAUST DUCT AND WASTE HEAT BOILER EXHAUST DUCT 8-10 DUCT DIAMETERS DOWNSTREAM AND TWO (2) EQUIVALENT DUCT DIAMETERS UPSTREAM OF ANY FLOW DISTURBANCE AND SHALL CONSIST OF TWO 4-INCH WELDED NIPPLES WITH CAPS. OWNER/OPERATOR SHALL PROVIDE ADEQUATE AND SAFE ACCESS TO THE TEST PORTS. AN EQUIVALENT METHOD SHALL BE USED UPON PRIOR APPROVAL BY THE SCAQMD.
[RULE 217]
11. UCLA SHALL CONDUCT ANNUAL PERFORMANCE TESTS IN ACCORDANCE WITH SCAQMD TEST PROCEDURES AND FURNISH THE SCAQMD WRITTEN RESULTS OF SUCH PERFORMANCE TESTS WITHIN 45 DAYS AFTER TESTING. ALL SOURCE TESTING PROCEDURES AND ANALYTICAL METHODS SHALL BE SUBMITTED TO THE SCAQMD FOR APPROVAL AT LEAST 60 DAYS PRIOR TO START OF TESTS.

THE TEST SHALL INCLUDE THE FOLLOWING CONTAMINANTS AT THE SPECIFIED LOCATIONS OF FUEL INLET TO TURBINE, TURBINE EXHAUST PRIOR TO CATALYST/SCR, AND/OR FINAL STACK EXHAUST WHILE FUELED WITH BLENDED NATURAL AND LANDFILL GAS:



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

- A. METHANE (FUEL INLET)
 - B. TOTAL NONMETHANE HYDROCARBONS (FUEL INLET, STACK)
 - C. AMMONIA (STACK EXHAUST)
- [RULE 1134, RULE 1303 (a)(1), RULE 1303 (b)(2)]
12. AMMONIA SHALL BE CONTINUOUSLY INJECTED WHENEVER THE CATALYST INLET TEMPERATURE REACHES 500 DEGREES F AND THE ELECTRIC OUTPUT OF THE TURBINE REACHES 4.5 MEGAWATTS, UNLESS OTHERWISE APPROVED IN WRITING BY THE SCAQMD.
[RULE 1303 (a)(1)]
13. THE OPERATOR SHALL KEEP THE FOLLOWING RECORDS:
- A. DATES AND TIMES OF START-UPS AND SHUT-DOWNS.
 - B. QUANTITY OF NATURAL GAS, LANDFILL GAS AND FUEL OIL BURNED.
 - C. REASONS WHY NATURAL GAS OR BLENDED NATURAL AND LANDFILL GAS WAS NOT USED AND THE NUMBER OF HOURS DURING WHICH BACK-UP FUEL WAS USED.
 - D. RESULTS FROM THE MONITORS REQUIRED BY PERMIT CONDITION NOS. 4 AND 5.
- RECORDS OF THE COGENERATION SYSTEM SHALL BE MAINTAINED BY UCLA AND SHALL BE MADE AVAILABLE TO AQMD PERSONNEL UPON REQUEST.
[RULE 1134, RULE 1303 (a)(1), RULE 1303 (b)(2)]

Periodic Monitoring:

14. THE OPERATOR SHALL INSTALL AND MAINTAIN A TEMPERATURE GAUGE TO ACCURATELY INDICATE THE TEMPERATURE AT THE INLET OF THE CATALYST. THE OPERATOR SHALL ALSO INSTALL AND MAINTAIN A DEVICE TO CONTINUOUSLY RECORD THE PARAMETER BEING MEASURED.
[RULE 3004 (a)(4)]

Emissions And Requirements:

15. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

NH3: 20 PPMV, RULE 1303 (a)(1)



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F71100
A/N 431761

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, MODEL NO. 3516B, DIESEL-FUELED, 16-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 2499 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT STRB II BLDG.).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT OPERATE MORE THAN 200 HOURS IN ANY ONE YEAR, WHICH INCLUDES NO MORE THAN 30 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING PURPOSES.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG SHALL BE KEPT AND MAINTAINED ON FILE TO RECORD WHEN THIS ENGINE IS STARTED MANUALLY. THE LOG SHALL LIST THE DATE OF OPERATION, THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION, AND THE REASON FOR OPERATION OF THIS ENGINE. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION (BOTH MANUAL AND AUTOMATIC) FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED ANYTIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304 (a)(4), RULE 1470]
6. OPERATION BEYOND THE 30 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1304 (a)(4), RULE 1470]

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE ENGINES UNDER APPLICATION NUMBERS 431761 AND 431762 SHALL NOT BE TESTED ON THE SAME DAYS.
[RULE 212]
9. THE DURATION OF THE TESTS FOR EACH ENGINE UNDER APPLICATION NUMBERS 431761 AND 431762 SHALL NOT EXCEED ONE HOUR AT ANY ONE TIME.
[RULE 212]
10. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
11. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

12. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F71101
A/N 431762

Equipment Description:

INTERNAL COMBUSTION ENGINE, CATERPILLAR, MODEL NO. 3516B, DIESEL-FUELED, 16-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 2499 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT CNSI BLDG.).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT OPERATE MORE THAN 200 HOURS IN ANY ONE YEAR, WHICH INCLUDES NO MORE THAN 30 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING PURPOSES.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG SHALL BE KEPT AND MAINTAINED ON FILE TO RECORD WHEN THIS ENGINE IS STARTED MANUALLY. THE LOG SHALL LIST THE DATE OF OPERATION, THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION, AND THE REASON FOR OPERATION OF THIS ENGINE. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION (BOTH MANUAL AND AUTOMATIC) FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED ANYTIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304 (a)(4), RULE 1470]
6. OPERATION BEYOND THE 30 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1304 (a)(4), RULE 1470]

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE ENGINES UNDER APPLICATION NUMBERS 431761 AND 431762 SHALL NOT BE TESTED ON THE SAME DAYS.
[RULE 212]
9. THE DURATION OF THE TESTS FOR EACH ENGINE UNDER APPLICATION NUMBERS 431761 AND 431762 SHALL NOT EXCEED ONE HOUR AT ANY ONE TIME.
[RULE 212]
10. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
11. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

12. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F73157
A/N 438367

Equipment Description:

INTERNAL COMBUSTION ENGINE, PERKINS, MODEL NO. 1104C-44TAG2, DIESEL-FUELED, 4-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 157.5 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT HEDRICK TOWER).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT OPERATE MORE THAN 200 HOURS IN ANY ONE YEAR, WHICH INCLUDES NO MORE THAN 50 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING PURPOSES.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG SHALL BE KEPT AND MAINTAINED ON FILE TO RECORD WHEN THIS ENGINE IS STARTED MANUALLY. THE LOG SHALL LIST THE DATE OF OPERATION, THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION, AND THE REASON FOR OPERATION OF THIS ENGINE. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION (BOTH MANUAL AND AUTOMATIC) FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED ANYTIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304 (a)(4), RULE 1470]
6. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1304 (a)(4), RULE 1470]

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F73384
A/N 438553

Equipment Description:

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, MODEL NO. 6063-HK35, DIESEL-FUELED, 6-CYLINDER, TURBOCHARGED AND AFTERCOOLED, 550 B.H.P, DRIVING AN EMERGENCY ELECTRICAL GENERATOR (LOCATED AT HILLBLOM RESEARCH CENTER).

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. AN OPERATIONAL NON RESETTABLE TOTALIZING TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304 (a)(4), RULE 1470]
4. THIS ENGINE SHALL NOT OPERATE MORE THAN 200 HOURS IN ANY ONE YEAR, WHICH INCLUDES NO MORE THAN 50 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING PURPOSES.
[RULE 1304 (a)(4), RULE 1470]
5. AN ENGINE OPERATING LOG SHALL BE KEPT AND MAINTAINED ON FILE TO RECORD WHEN THIS ENGINE IS STARTED MANUALLY. THE LOG SHALL LIST THE DATE OF OPERATION, THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION, AND THE REASON FOR OPERATION OF THIS ENGINE. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION (BOTH MANUAL AND AUTOMATIC) FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED ANYTIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304 (a)(4), RULE 1470]
6. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

[RULE 1304 (a)(4), RULE 1470]

7. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
8. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
9. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

10. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F82410
A/N 447811

Equipment Description:

(located at Rieber North)

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 6063-HK35, SERIAL NO. 06R0786142, TURBOCHARGED, AFTERCOOLED, 6 CYLINDERS, FOUR CYCLE, 635 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F82411
A/N 447812

Equipment Description:

(located at Rieber West)

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 6063-HK35, SERIAL NO. 06R0755508, TURBOCHARGED, AFTERCOOLED, 6 CYLINDERS, FOUR CYCLE, 635 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F90961
A/N 448155

Equipment Description:

(located at Engineering I Building)

INTERNAL COMBUSTION ENGINE, MITSUBISHI, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. S12R-YIPTA-2, TURBOCHARGED, 12 CYLINDERS, 1881 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F79657
A/N 448157

Equipment Description:

(located at Warren Hall)

BOILER, SELLERS, MODEL NO. 125HP-SL-LN390, SERIAL NO. 99704, RATED AT 4,952,755 BTU/HR, NATURAL GAS-FIRED, WITH A 4.95 MMBTU/HR SELLERS GAS AIR PREMIX LOW NO_x BURNERS.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS BOILER SHALL BE FIRED WITH NATURAL GAS ONLY.
[RULE 1146.1]
4. THIS BOILER SHALL EMIT NO MORE THAN 30 PPM OF OXIDES OF NITROGEN (NO_x), CALCULATED AS NO₂, AND NO MORE THAN 400 PPM OF CARBON MONOXIDE (CO), ALL MEASURED BY VOLUME ON A DRY BASIS AT 3% O₂.
[RULE 1146.1]
5. THIS BOILER SHALL COMPLY WITH RULE 1146.1.
[RULE 1146.1]

Emissions And Requirements:

6. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

CO: 2000 PPMV, RULE 407
CO: 400 PPMV, RULE 1146.1
NOX: 30 PPMV, RULE 1146.1
PM: 0.1 GR/SCF, RULE 409



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F78903
A/N 448158

Equipment Description:

(located at the UCLA Replacement Hospital)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 3516B DITA (2000 KW), SERIAL NO. 1HZ02177, TURBOCHARGED, AFTERCOOLED, 16 CYLINDERS, FOUR CYCLE, 2847 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F78904
A/N 448159

Equipment Description:

(located at the UCLA Replacement Hospital)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 3516B DITA (2000 KW), SERIAL NO. 1HZ02176, TURBOCHARGED, AFTERCOOLED, 16 CYLINDERS, FOUR CYCLE, 2847 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F78905
A/N 448160

Equipment Description:

(located at the UCLA Replacement Hospital)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 3516B DITA (2000 KW), SERIAL NO. 1HZ02175, TURBOCHARGED, AFTERCOOLED, 16 CYLINDERS, FOUR CYCLE, 2847 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F78906
A/N 448161

Equipment Description:

(located at the UCLA Replacement Hospital)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 3516B DITA (2000 KW), SERIAL NO. 1HZ02174, TURBOCHARGED, AFTERCOOLED, 16 CYLINDERS, FOUR CYCLE, 2847 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F82412
A/N 448551

Equipment Description:

(located at the Powell/Kinsey Buildings)

INTERNAL COMBUSTION ENGINE, CUMMINS, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. QSX15-G9, SERIAL NO. 79141009, TURBOCHARGED, AFTERCOOLED, 6 CYLINDERS, 755 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. N19559
A/N 451548

Equipment Description:

FUEL STORAGE AND DISPENSING FACILITY (LOCATED AT FLEET SERVICE) CONSISTING OF:

1. 8- GASOLINE BELLOWS-LESS NOZZLES DISPENSING 8 PRODUCTS, EQUIPPED WITH PHASE II VAPOR RECOVERY SYSTEM, HEALY PHASE II EVR SYSTEM NOT INCLUDING ISD (VR-201-C).
2. 2- GASOLINE UNDERGROUND STORAGE TANKS, EACH 10,000-GALLON CAPACITY, EQUIPPED WITH PHASE I VAPOR RECOVERY SYSTEM CNI MANUFACTURING (VR-104-B), 2 METHANOL COMPATIBLE.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE IN COMPLIANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT WAS ISSUED, UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. EXCEPT FOR DIESEL TRANSFERS, PHASE I VAPOR RECOVERY SYSTEMS SHALL BE IN FULL OPERATION WHENEVER FUEL IS BEING TRANSFERRED INTO STORAGE TANKS.
[RULE 461, RULE 1303 (a)(1)]
4. EXCEPT FOR DIESEL TRANSFER, PHASE II VAPOR RECOVERY SYSTEMS SHALL BE IN FULL OPERATION WHENEVER FUEL IS BEING TRANSFERRED INTO MOTOR VEHICLES, AS DEFINED IN RULE 461.
[RULE 461, RULE 1303 (a)(1)]
5. ALL PHASE I AND PHASE II VAPOR RECOVERY EQUIPMENT AT THIS FACILITY SHALL BE INSTALLED, OPERATED AND MAINTAINED TO MEET ALL CALIFORNIA AIR RESOURCES BOARD CERTIFICATION REQUIREMENTS.
[RULE 461]
6. A PRESSURE INTEGRITY TEST OF THE DROP TUBE/DRAIN VALVE ASSEMBLY SHALL BE CONDUCTED TO QUANTIFY THE PRESSURE INTEGRITY OF BOTH THE DROP TUBE AND DRAIN VALVE SEAL. THE TEST SHALL BE CONDUCTED IN ACCORDANCE WITH TEST PROCEDURE METHOD TP-201.1C AS A PERFORMANCE TEST AND AS A REVERIFICATION TEST. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE, WITHIN SEVENTY-TWO (72) HOURS OF TEST.
[RULE 461]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. A LEAK RATE AND CRACKING PRESSURE TEST OF PRESSURE/VACUUM RELIEF VENT VALVES SHALL BE CONDUCTED WITHIN THIRTY DAYS (30) AFTER THE START OF OPERATION OF THE CNI MANUFACTURING PHASE I EVR EQUIPMENT AND AT LEAST ONCE EVERY THREE (3) YEARS THEREAFTER TO DETERMINE THE PRESSURE AND VACUUM AT WHICH THE PRESSURE/VACUUM VENT VALVE ACTUATES, AND TO DETERMINE THE VOLUMETRIC LEAK RATE AT A GIVEN PRESSURE. THE TEST SHALL BE CONDUCTED IN ACCORDANCE WITH THE TEST PROCEDURE METHOD TP-201.1E. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE, WITHIN SEVENTY-TWO (72) HOURS OF TEST. THIS TEST RESULT SHALL BE KEPT ON SITE FOR FIVE (5) YEARS AND MADE AVAILABLE TO DISTRICT REPRESENTATIVES UPON REQUEST.

[RULE 461]

8. A STATIC TORQUE TEST OF ROTATABLE PHASE I ADAPTORS SHALL BE CONDUCTED TO QUANTIFY THE AMOUNT OF STATIC TORQUE REQUIRED TO START THE ROTATION OF THE ROTATABLE PHASE I ADAPTORS. THE TEST SHALL BE CONDUCTED IN ACCORDANCE WITH THE TEST PROCEDURE METHOD OUTLINED IN TP-201.1B AS A PERFORMANCE TEST AND AS A REVERIFICATION TEST. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE, WITHIN SEVENTY-TWO (72) HOURS OF TEST.

[RULE 461]

9. THE PHASE II VAPOR RECOVERY SYSTEM SHALL BE INSTALLED, OPERATED, AND MAINTAINED SUCH THAT THE MAXIMUM ALLOWABLE PRESSURE THROUGH THE RISER, AND UNDERGROUND PIPING DOES NOT EXCEED THE DYNAMIC BACK PRESSURE DESCRIBED BY THE CALIFORNIA AIR RESOURCES BOARD EXECUTIVE ORDER BY WHICH THE SYSTEM WAS CERTIFIED:

NITROGEN FLOWRATES
(CFH)
60

DYNAMIC BACK PRESSURE
(INCHES OF WATER)
0.50

DYNAMIC BACK PRESSURE TESTS SHALL BE CONDUCTED TO DETERMINE THE PHASE II SYSTEM VAPOR RECOVERY BACK PRESSURES. THE TESTS SHALL BE CONDUCTED IN ACCORDANCE WITH CARB TEST PROCEDURE TP-201.4, METHODOLOGY 4; AS A PERFORMANCE TEST. THIS TEST SHALL BE A ONE-TIME TEST AND THE RESULTS KEPT PERMANENTLY ON SITE. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE, WITHIN SEVENTY-TWO (72) HOURS OF TESTS.

[RULE 461]

10. A STATIC PRESSURE LEAK DECAY TEST SHALL BE CONDUCTED TO DEMONSTRATE THAT THE STORAGE TANKS, THE REMOTE AND/OR NOZZLE VAPOR RECOVERY CHECK VALVES, ASSOCIATED VAPOR RETURN PIPING AND FITTINGS ARE FREE FROM VAPOR LEAKS. THE TEST SHALL BE CONDUCTED IN ACCORDANCE WITH CARB TEST PROCEDURE METHOD TP-201.3 AS A PERFORMANCE TEST AND AS A REVERIFICATION TEST. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE, WITHIN SEVENTY-TWO (72) HOURS OF TEST.

[RULE 461]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

11. A STATIC PRESSURE PERFORMANCE TEST FOR THE HEALY CLEAN AIR SEPARATOR USING BOTH THE VACUUM DECAY PROCEDURE AND THE POSITIVE PRESSURE PROCEDURE SHALL BE CONDUCTED TO QUANTIFY THE VAPOR TIGHTNESS OF THE HEALY CLEAN AIR SEPARATOR TANK PRESSURE MANAGEMENT SYSTEM. THESE TESTS SHALL BE CONDUCTED IN ACCORDANCE WITH EXHIBIT 4 OF CARB EXECUTIVE ORDER VR-201-C AS A PERFORMANCE TEST AND REVERIFICATION TEST. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE WITHIN SEVENTY-TWO (72) HOURS OF TEST.
[RULE 461]
12. A VAPOR TO LIQUID VOLUME RATIO TEST SHALL BE CONDUCTED TO QUANTIFY THE VAPOR TO LIQUID (V/L) VOLUMETRIC RATIO OF THE HEALY CLEAN AIR SEPARATOR SYSTEM. THE TEST SHALL BE CONDUCTED IN ACCORDANCE WITH EXHIBIT 5 OF CARB EXECUTIVE ORDER VR-201-C AS A PERFORMANCE TEST AND AS A REVERIFICATION TEST. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE WITHIN SEVENTY-TWO (72) HOURS OF TEST.
[RULE 461]
13. A NOZZLE BAG TEST SHALL BE CONDUCTED ON THE HEALY PHASE II EVR NOZZLES TO VERIFY THE INTEGRITY OF THE VAPOR VALVE. THE TEST SHALL BE CONDUCTED ON ANY NEWLY INSTALLED OR REPLACED HEALY PHASE II EVR NOZZLES AND IN ACCORDANCE WITH EXHIBIT 7 OF CARB EXECUTIVE ORDER VR-201-C. RESULTS SHALL BE SUBMITTED TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE WITHIN SEVENTY-TWO (72) HOURS OF TEST.
[RULE 461]
14. THE STATIC PRESSURE LEAK DECAY TEST TP-201.3, SHALL BE CONDUCTED IN ACCORDANCE WITH EXHIBIT 8 OF CARB EXECUTIVE ORDER VR-201-C. VERIFICATION OF COMPLETING EACH STEP AS OUTLINED SHALL BE DOCUMENTED BY SUBMITTING A COPY OF EXHIBIT 8 TO THE AQMD, OFFICE OF ENGINEERING AND COMPLIANCE WITHIN SEVENTY-TWO (72) HOURS OF TEST.
[RULE 461]
15. THE AQMD SHALL BE NOTIFIED BY E-MAIL AT R461TESTING@AQMD.GOV OR BY FACSIMILE AT TELEPHONE NUMBER (909) 396-3606 AT LEAST SEVENTY-TWO (72) HOURS PRIOR TO ANY OF THE ABOVE MENTIONED TESTING REQUIREMENTS. SUCH NOTIFICATION SHALL INCLUDE THE NAME OF THE OWNER OR OPERATOR; THE NAME OF THE CONTRACTOR; THE LOCATION OF THE FACILITY; AND THE SCHEDULED START AND COMPLETION DATES OF THE TESTS TO BE PERFORMED.
[RULE 461]
16. THE TESTING FOR THE ABOVE MENTIONED TESTS SHALL BE CONDUCTED IN ACCORDANCE WITH THE MOST RECENT RULE 461 AMENDMENT OR CARB EXECUTIVE ORDER REQUIREMENTS, WHICHEVER IS MORE STRINGENT.
[RULE 461]
17. ALL RECORDS AND TEST RESULTS THAT ARE REQUIRED TO BE MAINTAINED BY RULE 461 SHALL BE KEPT ON SITE FOR FIVE YEARS AND MADE AVAILABLE TO DISTRICT REPRESENTATIVES UPON REQUEST.
[RULE 461]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

18. THE MAXIMUM QUANTITY OF GASOLINE DISPENSED FROM THE STORAGE TANKS AT THIS FACILITY SHALL NOT EXCEED 53,000 GALLONS IN ANY ONE CALENDAR MONTH NOR 636,000 GALLONS IN ANY ONE CALENDAR YEAR.
[RULE 1303 (b)(2), RULE 1401]
19. FOR ISD REQUIREMENTS ONLY, THIS FACILITY SHALL NOT DISPENSE MORE THAN 600,000 GALLONS OF GASOLINE PER CALENDAR YEAR. SHOULD THE FACILITY DISPENSE MORE THAN 600,000 GALLONS OF GASOLINE PER CALENDAR YEAR, THE OPERATOR SHALL IMMEDIATELY CEASE ALL GASOLINE DISPENSING OPERATIONS AND FILE AN APPLICATION FOR A PERMIT TO CONSTRUCT/OPERATE TO INSTALL A CARB CERTIFIED ISD SYSTEM. GASOLINE DISPENSING OPERATIONS SHALL NOT RESUME UNTIL THE ISD SYSTEM HAS BEEN GRANTED A PERMIT TO CONSTRUCT/OPERATE AND FULLY INSTALLED.
[RULE 461]
20. RECORDS OF MONTHLY AND ANNUAL FUEL DISPENSED SHALL BE PREPARED, SHALL BE RETAINED ON SITE FOR FIVE YEARS, AND SHALL BE MADE AVAILABLE TO DISTRICT REPRESENTATIVES UPON REQUEST.
[RULE 1303 (b)(2), RULE 1401].

Periodic Monitoring:

21. THE OPERATOR SHALL HAVE A PERSON THAT HAS BEEN TRAINED IN ACCORDANCE WITH RULE 461(d)(5) CONDUCT A SEMI-ANNUAL INSPECTION OF THE GASOLINE TRANSFER AND DISPENSING EQUIPMENT. THE FIRST INSPECTION SHALL BE IN ACCORDANCE WITH RULE 461, ATTACHMENT B, THE SECOND INSPECTION SHALL BE IN ACCORDANCE WITH RULE 461, ATTACHMENT C, AND THE SUBSEQUENT INSPECTIONS SHALL ALTERNATE PROTOCOLS. THE OPERATOR SHALL KEEP RECORDS OF THE INSPECTION AND THE REPAIRS IN ACCORDANCE TO RULE 461 AND SECTION K OF THIS PERMIT.
[RULE 3004 (a)(4)]

Emissions And Requirements:

22. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

VOC: RULE 461
VOC: RULE 1170



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. F89260
A/N 455087**

Equipment Description:

(located at the Math Science Building)

INTERNAL COMBUSTION PERKINS, CUMMINS, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. GCD325, SERIAL NO. NNS01360, TURBOCHARGED, AFTERCOOLED, SIX CYLINDERS, 325 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F84400
A/N 459848

Equipment Description:

(located at CHS Hospital & Clinics # EGS-1)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. D399, SERIAL NO. 35B1071, TURBOCHARGED, SIXTEEN CYLINDERS, 4-CYCLE, 1260 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL BE REMOVED FROM OFFICE OF STATEWIDE HEALTH PLANNING DEVELOPMENT (OSHPD) SERVICE PRIOR TO JANUARY 1, 2009.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]
8. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:
 - A. EMERGENCY USE HOURS OF OPERATION
 - B. MAINTENANCE AND TESTING HOURS
 - C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
9. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
10. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
11. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

12. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F84399
A/N 459849

Equipment Description:

(located at CHS Hospital & Clinics # EGS-2)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. D399, SERIAL NO. 35B1072, TURBOCHARGED, SIXTEEN CYLINDERS, 4-CYCLE, 1260 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL BE REMOVED FROM OFFICE OF STATEWIDE HEALTH PLANNING DEVELOPMENT (OSHPD) SERVICE PRIOR TO JANUARY 1, 2009.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]
8. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:
 - A. EMERGENCY USE HOURS OF OPERATION
 - B. MAINTENANCE AND TESTING HOURS
 - C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
9. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
10. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
11. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

12. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F84398
A/N 459850

Equipment Description:

(located at CHS Hospital & Clinics # EGS-3)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. D399, SERIAL NO. 35B4263, TURBOCHARGED, SIXTEEN CYLINDERS, 4-CYCLE, 1310 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL BE REMOVED FROM OFFICE OF STATEWIDE HEALTH PLANNING DEVELOPMENT (OSHPD) SERVICE PRIOR TO JANUARY 1, 2009.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]
8. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:
 - A. EMERGENCY USE HOURS OF OPERATION
 - B. MAINTENANCE AND TESTING HOURS
 - C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
9. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
10. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
11. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

12. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F84397
A/N 459851

Equipment Description:

(located at CHS Hospital & Clinics # EGS-4)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. D399, SERIAL NO. 35B4258, TURBOCHARGED, SIXTEEN CYLINDERS, 4-CYCLE, 1310 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL BE REMOVED FROM OFFICE OF STATEWIDE HEALTH PLANNING DEVELOPMENT (OSHPD) SERVICE PRIOR TO JANUARY 1, 2009.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]
8. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:
 - A. EMERGENCY USE HOURS OF OPERATION
 - B. MAINTENANCE AND TESTING HOURS
 - C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
9. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
10. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
11. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

12. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F84396
A/N 459852

Equipment Description:

(located at CHS Hospital & Clinics, Radiology)

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 12V-149TI, SERIAL NO. 6537329, TURBOCHARGED, AFTERCOOLED, TWELVE CYLINDERS, 1750 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL BE REMOVED FROM OFFICE OF STATEWIDE HEALTH PLANNING DEVELOPMENT (OSHPD) SERVICE PRIOR TO JANUARY 1, 2009.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]
8. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303 (a)(1)-BACT]
9. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:
 - A. EMERGENCY USE HOURS OF OPERATION
 - B. MAINTENANCE AND TESTING HOURS
 - C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
10. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
11. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
12. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

13. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F95749
A/N 473877

Equipment Description:

(located at Parking Structure #3)

INTERNAL COMBUSTION ENGINE, PERKINS, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 1104C (2460/1800), SERIAL NO. RE51214 U154253L, NATURALLY ASPIRATED, FOUR CYLINDERS, 4-CYCLE, 72.4 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

- A. EMERGENCY USE HOURS OF OPERATION
- B. MAINTENANCE AND TESTING HOURS
- C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]
9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]
10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F95750
A/N 473878

Equipment Description:

(located at PS 5, 4, 7, Wooden & Ashe Centers)

INTERNAL COMBUSTION ENGINE, CATERPILLAR, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 3516C-DITA, TURBOCHARGED, AFTERCOOLED, SIXTEEN CYLINDERS, 4-CYCLE, 3622 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F95751
A/N 475260

Equipment Description:

(located at Engineering V Bldg.)

INTERNAL COMBUSTION ENGINE, DETROIT DIESEL, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. T1638A36, TURBOCHARGED, AFTERCOOLED, SIXTEEN CYLINDERS, 4-CYCLE, 3057 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. F97591
A/N 481972

Equipment Description:

(located at Life Sciences Replacement Bldg.)

INTERNAL COMBUSTION ENGINE, CUMMINS, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. QSK50-G4 NR2, TURBOCHARGED, AFTERCOOLED, SIXTEEN CYLINDERS, 2220 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS FOR MAINTENANCE AND PERFORMANCE TESTING.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE MAINTAINED WHICH ON A MONTHLY BASIS SHALL LIST ALL ENGINE OPERATIONS IN EACH OF THE FOLLOWING AREAS:

A. EMERGENCY USE HOURS OF OPERATION

B. MAINTENANCE AND TESTING HOURS

C. OTHER OPERATING HOURS (DESCRIBE THE REASON FOR OPERATION)

IN ADDITION, EACH TIME THE ENGINE IS STARTED MANUALLY, THE LOG SHALL INCLUDE THE DATE OF OPERATION AND THE TIMER READING IN HOURS AT THE BEGINNING AND END OF OPERATION. THE LOG SHALL BE KEPT FOR A MINIMUM OF FIVE CALENDAR YEARS PRIOR TO THE CURRENT YEAR AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST. THE TOTAL HOURS OF OPERATION FOR THE PREVIOUS CALENDAR YEAR SHALL BE RECORDED SOMETIME DURING THE FIRST 15 DAYS OF JANUARY OF EACH YEAR.

[RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 1470.
[RULE 1470]

9. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.
[RULE 1470, RULE 431.2]

10. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST
[RULE 1470, RULE 431.2]

Emissions And Requirements:

11. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. G3897
A/N 498393

Equipment Description:

(located at the Spieker Aquatic Center)

INTERNAL COMBUSTION ENGINE, JOHN DEERE, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 4024HF285B, TURBOCHARGED, AFTERCOOLED, FOUR CYLINDERS, 80 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING, AND NO MORE THAN 4.2 HOURS IN ANY ONE MONTH FOR MAINTENANCE AND TESTING.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470, RULE 1472]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THE OPERATOR SHALL KEEP A LOG OF ENGINE OPERATIONS DOCUMENTING THE TOTAL TIME THE ENGINE IS OPERATED EACH MONTH AND THE SPECIFIC REASON FOR OPERATION AS :

- A. EMERGENCY USE
- B. MAINTENANCE AND TESTING
- C. OTHERS (SPECIFY)

IN ADDITION, FOR EACH TIME THE ENGINE IS MANUALLY STARTED, THE LOG SHALL INCLUDE THE DATE OF ENGINE OPERATION, THE SPECIFIC REASON FOR OPERATION, AND THE TOTALIZING HOUR METER READINGS (IN HOURS AND TENTHS OF HOURS) AT THE BEGINNING AND THE END OF THE OPERATION.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. ON OR BEFORE JANUARY 15TH OF EACH YEAR, THE OPERATOR SHALL RECORD IN THE ENGINE OPERATING LOG :

- A. THE TOTAL HOURS OF ENGINE OPERATION FOR THE PREVIOUS CALENDAR YEAR, AND

- B. THE TOTAL HOURS OF ENGINE OPERATION FOR MAINTENANCE AND TESTING FOR THE PREVIOUS CALENDAR YEAR.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

9. ENGINE OPERATION LOGS SHALL BE RETAINED ON SITE FOR A MINIMUM OF FIVE CALENDAR YEARS AND SHALL BE MADE AVAILABLE TO THE EXECUTIVE OFFICER OR HIS REPRESENTATIVE UPON REQUEST.

[RULE 1470]

10. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULES 1470 AND 1472.

[RULE 1470, RULE 1472]

11. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.

[RULE 1470, RULE 431.2]

12. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST

[RULE 1470, RULE 431.2]

Emissions And Requirements:

13. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

PERMIT TO OPERATE

Permit No. G3896
A/N 498553

Equipment Description:

(located at the Rieber Hall)

INTERNAL COMBUSTION ENGINE, JOHN DEERE, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. 6135HF485T, TURBOCHARGED, AFTERCOOLED, SIX CYLINDERS, 538 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL NOT BE OPERATED MORE THAN A TOTAL OF 200 HOURS IN ANY ONE YEAR WHICH INCLUDES NO MORE THAN 50 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING, AND NO MORE THAN 4.2 HOURS IN ANY ONE MONTH FOR MAINTENANCE AND TESTING.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
4. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470, RULE 1472]
5. OPERATION BEYOND THE 50 HOURS PER YEAR ALLOTTED FOR ENGINE MAINTENANCE AND TESTING SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THIS ENGINE SHALL NOT BE USED AS PART OF A DEMAND RESPONSE PROGRAM USING INTERRUPTIBLE SERVICE CONTRACT IN WHICH A FACILITY RECEIVES A PAYMENT OR REDUCED RATES IN RETURN FOR REDUCING ITS ELECTRIC LOAD ON THE GRID WHEN REQUESTED TO DO SO BY THE UTILITY OR THE GRID OPERATOR.
[RULE 1470]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. THE OPERATOR SHALL KEEP A LOG OF ENGINE OPERATIONS DOCUMENTING THE TOTAL TIME THE ENGINE IS OPERATED EACH MONTH AND THE SPECIFIC REASON FOR OPERATION AS :

- A. EMERGENCY USE
- B. MAINTENANCE AND TESTING
- C. OTHERS (SPECIFY)

IN ADDITION, FOR EACH TIME THE ENGINE IS MANUALLY STARTED, THE LOG SHALL INCLUDE THE DATE OF ENGINE OPERATION, THE SPECIFIC REASON FOR OPERATION, AND THE TOTALIZING HOUR METER READINGS (IN HOURS AND TENTHS OF HOURS) AT THE BEGINNING AND THE END OF THE OPERATION.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. ON OR BEFORE JANUARY 15TH OF EACH YEAR, THE OPERATOR SHALL RECORD IN THE ENGINE OPERATING LOG :

A. THE TOTAL HOURS OF ENGINE OPERATION FOR THE PREVIOUS CALENDAR YEAR, AND

B. THE TOTAL HOURS OF ENGINE OPERATION FOR MAINTENANCE AND TESTING FOR THE PREVIOUS CALENDAR YEAR.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

9. ENGINE OPERATION LOGS SHALL BE RETAINED ON SITE FOR A MINIMUM OF FIVE CALENDAR YEARS AND SHALL BE MADE AVAILABLE TO THE EXECUTIVE OFFICER OR HIS REPRESENTATIVE UPON REQUEST.

[RULE 1470]

10. THIS EQUIPMENT SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULES 1470 AND 1472.

[RULE 1470, RULE 1472]

11. THE OPERATOR SHALL ONLY USE LOW SULFUR DIESEL FUEL WITH A SULFUR CONTENT OF 15 PPM OR LESS BY WEIGHT.

[RULE 1470, RULE 431.2]

12. MATERIAL SAFETY DATA SHEETS FOR THE DIESEL FUEL USED IN THIS ENGINE SHALL BE KEPT CURRENT AND MADE AVAILABLE TO DISTRICT PERSONNEL UPON REQUEST

[RULE 1470, RULE 431.2]

Emissions And Requirements:

13. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. G9381
A/N 503209**

Equipment Description:

[located at the 100 Medical Plaza Bldg.]

INTERNAL COMBUSTION ENGINE, CLARKE GM DIESEL, DIESEL-FUELED, EMERGENCY FIRE PUMP DRIVER, MODEL NO. D226-6, SERIAL NO. D226-6-17325, SIX CYLINDERS, 4-CYCLE, 103 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 431.2 AND RULE 1470.
[RULE 431.2, RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN 200 HOURS IN ANY ONE YEAR, WHICH INCLUDES NO MORE THAN 34 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING TO COMPLY WITH THE REQUIREMENTS OF THE NATIONAL FIRE PROTECTION ASSOCIATION.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. THE FUEL INJECTION TIMING OF THIS ENGINE SHALL BE SET AND MAINTAINED AT 4 DEGREES RETARDED RELATIVE TO STANDARD TIMING.
[RULE 1303(a)(1)-BACT]
7. AN ENGINE OPERATING LOG SHALL BE KEPT AND MAINTAINED, DOCUMENTING THE TOTAL TIME THE ENGINE IS OPERATED EACH MONTH AND THE SPECIFIC REASON FOR OPERATION AS:
 - A. EMERGENCY USE.
 - B. MAINTENANCE AND TESTING.
 - C. OTHER (DESCRIBE THE REASON FOR OPERATING).



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

IN ADDITION, EACH TIME THE ENGINE IS MANUALLY STARTED, THE LOG SHALL INCLUDE THE DATE OF OPERATION, THE SPECIFIC REASON FOR OPERATION, AND THE TOTALIZING HOUR METER READING (IN HOURS AND TENTHS OF HOURS) AT THE BEGINNING AND END OF OPERATION.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. ON OR BEFORE JANUARY 15TH OF EACH YEAR, THE OPERATOR SHALL RECORD IN THE ENGINE OPERATING LOG :

- A. THE TOTAL HOURS OF ENGINE OPERATION FOR THE PREVIOUS CALENDAR YEAR, AND
- B. THE TOTAL HOURS OF ENGINE OPERATION FOR MAINTENANCE AND TESTING FOR THE PREVIOUS CALENDAR YEAR.

THE ENGINE OPERATING LOG SHALL BE RETAINED ON SITE FOR A MINIMUM OF FIVE CALENDAR YEARS AND SHALL BE MADE AVAILABLE TO THE EXECUTIVE OFFICER OR REPRESENTATIVE UPON REQUEST.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

Emissions And Requirements:

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1470



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PERMIT TO OPERATE

**Permit No. G9382
A/N 503210**

Equipment Description:

(located at the 100 Medical Plaza Bldg.)

INTERNAL COMBUSTION ENGINE, CUMMINS, DIESEL-FUELED, EMERGENCY ELECTRICAL GENERATION, MODEL NO. NTA855-G2, SERIAL NO. 11575855, TURBOCHARGED, AFTERCOOLED, SIX CYLINDERS, 465 BHP.

Conditions:

1. OPERATION OF THIS EQUIPMENT SHALL BE CONDUCTED IN ACCORDANCE WITH ALL DATA AND SPECIFICATIONS SUBMITTED WITH THE APPLICATION UNDER WHICH THIS PERMIT IS ISSUED UNLESS OTHERWISE NOTED BELOW.
[RULE 204]
2. THIS EQUIPMENT SHALL BE PROPERLY MAINTAINED AND KEPT IN GOOD OPERATING CONDITION AT ALL TIMES.
[RULE 204]
3. THIS ENGINE SHALL COMPLY WITH ALL APPLICABLE REQUIREMENTS OF RULE 431.2 AND RULE 1470.
[RULE 431.2, RULE 1470]
4. THIS ENGINE SHALL NOT BE OPERATED MORE THAN 200 HOURS IN ANY ONE YEAR, WHICH INCLUDES NO MORE THAN 20 HOURS IN ANY ONE YEAR FOR MAINTENANCE AND TESTING AND NO MORE THAN 1.7 HOURS IN ANY ONE MONTH FOR MAINTENANCE AND TESTING.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
5. OPERATING BEYOND THE 20 HOURS PER YEAR ALLOTTED FOR MAINTENANCE AND TESTING PURPOSES SHALL BE ALLOWED ONLY IN THE EVENT OF A LOSS OF GRID POWER OR UP TO 30 MINUTES PRIOR TO A ROTATING OUTAGE, PROVIDED THAT THE UTILITY DISTRIBUTION COMPANY HAS ORDERED ROTATING OUTAGES IN THE CONTROL AREA WHERE THE ENGINE IS LOCATED OR HAS INDICATED THAT IT EXPECTS TO ISSUE SUCH AN ORDER AT A CERTAIN TIME, AND THE ENGINE IS LOCATED IN A UTILITY SERVICE BLOCK THAT IS SUBJECT TO THE ROTATING OUTAGE. ENGINE OPERATION SHALL BE TERMINATED IMMEDIATELY AFTER THE UTILITY DISTRIBUTION COMPANY ADVISES THAT A ROTATING OUTAGE IS NO LONGER IMMINENT OR IN EFFECT.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]
6. AN OPERATIONAL NON-RESETTABLE ELAPSED TIME METER SHALL BE INSTALLED AND MAINTAINED TO INDICATE THE ENGINE ELAPSED OPERATING TIME.
[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470, RULE 1472]



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

7. AN ENGINE OPERATING LOG SHALL BE KEPT AND MAINTAINED, DOCUMENTING THE TOTAL TIME THE ENGINE IS OPERATED EACH MONTH AND THE SPECIFIC REASON FOR OPERATION AS:

A. EMERGENCY USE.

B. MAINTENANCE AND TESTING.

C. OTHER (DESCRIBE THE REASON FOR OPERATING).

IN ADDITION, EACH TIME THE ENGINE IS MANUALLY STARTED, THE LOG SHALL INCLUDE THE DATE OF OPERATION, THE SPECIFIC REASON FOR OPERATION, AND THE TOTALIZING HOUR METER READING (IN HOURS AND TENTHS OF HOURS) AT THE BEGINNING AND END OF OPERATION.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

8. ON OR BEFORE JANUARY 15TH OF EACH YEAR, THE OPERATOR SHALL RECORD IN THE ENGINE OPERATING LOG :

A. THE TOTAL HOURS OF ENGINE OPERATION FOR THE PREVIOUS CALENDAR YEAR, AND

B. THE TOTAL HOURS OF ENGINE OPERATION FOR MAINTENANCE AND TESTING FOR THE PREVIOUS CALENDAR YEAR.

THE ENGINE OPERATING LOG SHALL BE RETAINED ON SITE FOR A MINIMUM OF FIVE CALENDAR YEARS AND SHALL BE MADE AVAILABLE TO THE EXECUTIVE OFFICER OR REPRESENTATIVE UPON REQUEST.

[RULE 1303(b)(2)-OFFSET, RULE 1304(a)-MODELING AND OFFSET, RULE 1470]

Emissions And Requirements:

9. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS

PM: RULE 1470



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, COATING EQUIPMENT, PORTABLE, ARCHITECTURAL COATINGS.

Periodic Monitoring:

1. THE OPERATOR SHALL KEEP RECORDS, IN A MANNER APPROVED BY THE DISTRICT, FOR THE FOLLOWING PARAMETER(S) OR ITEM(S):

FOR ARCHITECTURAL APPLICATIONS WHERE NO THINNERS, REDUCERS, OR OTHER VOC CONTAINING MATERIALS ARE ADDED, MAINTAIN SEMI-ANNUAL RECORDS OF ALL COATINGS CONSISTING OF (a) COATING TYPE, (b) VOC CONTENT AS SUPPLIED IN GRAMS PER LITER (g/l) OF MATERIALS FOR LOW-SOLIDS COATINGS, (c) VOC CONTENT AS SUPPLIED IN g/l OF COATING, LESS WATER AND EXEMPT SOLVENT, FOR OTHER COATING.

FOR OTHER ARCHITECTURAL APPLICATIONS WHERE THINNERS, REDUCERS, OR OTHER VOC CONTAINING MATERIALS ARE ADDED, MAINTAIN DAILY RECORDS FOR EACH COATING CONSISTING OF (a) COATING TYPE, (b) VOC CONTENT AS APPLIED IN GRAMS PER LITER (g/l) OF MATERIALS USED FOR LOW-SOLIDS COATINGS, (c) VOC CONTENT AS APPLIED IN g/l OF COATING, LESS WATER AND EXEMPT SOLVENT, FOR OTHER COATING.

[RULE 3004 (a) (4)]

Emissions And Requirements:

2. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATION:

VOC: RULE 1113, SEE APPENDIX B FOR EMISSION LIMITS

VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS



FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, HAND WIPING OPERATIONS.

Emissions And Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATION:

VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, BOILER, > 1 MMBTU/HR BUT < 2 MMBTU/HR.

Emissions And Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: 0.1 gr/scf, RULE 409
NOx: 30 PPMV, RULE 1146.2
CO: 400 PPMV, RULE 1146.2
CO: 2000 PPMV, RULE 407



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, PRINTING EQUIPMENT

Emissions And Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATION:

VOC: RULE 1130, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 1130.1, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, PORTABLE PAVEMENT STRIPERS, ARCHITECTURAL COATINGS.

Periodic Monitoring:

1. THE OPERATOR SHALL KEEP RECORDS, IN A MANNER APPROVED BY THE DISTRICT, FOR THE FOLLOWING PARAMETER(S) OR ITEM(S):

FOR ARCHITECTURAL APPLICATIONS WHERE NO THINNERS, REDUCERS, OR OTHER VOC CONTAINING MATERIALS ARE ADDED, MAINTAIN SEMI-ANNUAL RECORDS OF ALL COATINGS CONSISTING OF (a) COATING TYPE, (b) VOC CONTENT AS SUPPLIED IN GRAMS PER LITER (g/l) OF MATERIALS FOR LOW-SOLIDS COATINGS, (c) VOC CONTENT AS SUPPLIED IN g/l OF COATING, LESS WATER AND EXEMPT SOLVENT, FOR OTHER COATING.

FOR OTHER ARCHITECTURAL APPLICATIONS WHERE THINNERS, REDUCERS, OR OTHER VOC CONTAINING MATERIALS ARE ADDED, MAINTAIN DAILY RECORDS FOR EACH COATING CONSISTING OF (a) COATING TYPE, (b) VOC CONTENT AS APPLIED IN GRAMS PER LITER (g/l) OF MATERIALS USED FOR LOW-SOLIDS COATINGS, (c) VOC CONTENT AS APPLIED IN g/l OF COATING, LESS WATER AND EXEMPT SOLVENT, FOR OTHER COATING.

[RULE 3004 (a) (4)]

Emissions And Requirements:

2. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATION:

VOC: RULE 1113, SEE APPENDIX B FOR EMISSION LIMITS

VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, COOLING TOWERS

Emissions And Requirements:

- I. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATION:

CR⁺⁶: RULE 1404



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, HALON FIRE EXTINGUISHING EQUIPMENT

Emissions And Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATION:

HALON: RULE 1418



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, ABRASIVE BLASTING EQUIPMENT, GLOVE-BOX, < 53 FT³, WITH DUST FILTER.

Periodic Monitoring:

1. THE OPERATOR SHALL PERFORM AN ANNUAL INSPECTION OF THE EQUIPMENT AND FILTER MEDIA FOR LEAKS, BROKEN OR TORN FILTER MEDIA AND IMPROPERLY INSTALLED FILTER MEDIA. THE OPERATOR SHALL KEEP RECORDS, IN A MANNER APPROVED BY THE DISTRICT, FOR THE FOLLOWING PARAMETER(S) OR ITEM(S):
 - A. THE NAME OF THE PERSON PERFORMING THE INSPECTION AND/OR MAINTENANCE OF THE FILTER MEDIA;
 - B. THE DATE, TIME AND RESULTS OF THE INSPECTION; AND
 - C. THE DATE, TIME AND DESCRIPTION OF ANY MAINTENANCE OR REPAIRS RESULTING FROM THE INSPECTION.[RULE 3004 (a)(4)]

2. THE OPERATOR SHALL DISCHARGE DUST COLLECTED IN THIS EQUIPMENT ONLY INTO CLOSED CONTAINERS.
[RULE 3004 (a)(4)]

3. THE OPERATOR SHALL CONDUCT AN INSPECTION FOR VISIBLE EMISSIONS FROM ALL STACKS AND OTHER EMISSION POINTS OF THIS EQUIPMENT WHENEVER THERE IS A PUBLIC COMPLAINT OF VISIBLE EMISSIONS, WHENEVER VISIBLE EMISSIONS ARE OBSERVED, AND ON AN ANNUAL BASIS, AT LEAST, UNLESS THE EQUIPMENT DID NOT OPERATE DURING THE ENTIRE ANNUAL PERIOD. THE ROUTINE ANNUAL INSPECTION SHALL BE CONDUCTED WHILE THE EQUIPMENT IS IN OPERATION AND DURING DAYLIGHT HOURS. IF ANY VISIBLE EMISSIONS (NOT INCLUDING CONDENSED WATER VAPOR) ARE DETECTED, THE OPERATOR SHALL TAKE CORRECTIVE ACTION(S) THAT ELIMINATES THE VISIBLE EMISSIONS WITHIN 24 HOURS AND REPORT THE VISIBLE EMISSIONS AS A POTENTIAL DEVIATION IN ACCORDANCE WITH THE REPORTING REQUIREMENTS IN SECTION K OF THIS PERMIT.

THE OPERATOR SHALL KEEP THE RECORDS IN ACCORDANCE WITH THE RECORDKEEPING REQUIREMENTS IN SECTION K OF THIS PERMIT AND THE FOLLOWING RECORDS:

- A. STACK OR EMISSION POINT IDENTIFICATION;
 - B. DESCRIPTION OF ANY CORRECTIVE ACTIONS TAKEN TO ABATE VISIBLE EMISSIONS; AND
 - C. DATE AND TIME VISIBLE EMISSION WAS ABATED.
- [RULE 3004 (a)(4)]

Emissions And Requirements:

4. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

Section D Page 204
Facility I.D.#: 018452
Revision #: 11
Date: August 04, 2010

**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 405, SEE APPENDIX B FOR EMISSION LIMITS
PM: RULE 1140, SEE APPENDIX B FOR EMISSION LIMITS



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, REFRIGERATION UNITS

Emissions And Requirements:

- I. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

REFRIGERANT:	RULE 1415
REFRIGERANT:	40CFR 82 SUBPART F



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, AIR CONDITIONING UNITS

Emissions And Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

REFRIGERANT: RULE 1415
REFRIGERANT: 40CFR 82 SUBPART F



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, COATING EQUIPMENT, LOW USE OR EMISSIONS

Emissions And Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 1107, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 1136, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 109



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, CHARBROILER.

Periodic Monitoring:

1. THE OPERATOR SHALL KEEP RECORDS, IN A MANNER APPROVED BY THE DISTRICT, FOR THE FOLLOWING PARAMETER(S) OR ITEM(S):
 - A. DATE
 - B. DAILY OPERATING HOURS
 - C. DAILY AMOUNT OF MEAT COOKED (OR CASHIER'S RECEIPTS WHICH SHOW THE QUANTITY OF CHARBROILER PRODUCTS SOLD EACH DAY)[RULE 3004 (a)(4)]

Emissions And Requirements:

2. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATIONS:

PM: 0.1 GR/SCF, RULE 409
PM: RULE 404, SEE APPENDIX B FOR EMISSION LIMITS



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, NEGATIVE AIR MACHINES.

Periodic Monitoring:

1. FOR EACH COMMERCIAL ABATEMENT PROJECT, THE NEGATIVE AIR MACHINE(S) EXHAUST SHALL BE LOCATED A MINIMUM OF 3 METERS (10 FEET) FROM THE NEAREST RECEPTOR (ANY LOCATION WHERE THE PUBLIC CAN BE EXPOSED TO ASBESTOS FIBER EMISSIONS) AND SHALL BE LOCATED AT LEAST 10 FEET ABOVE THE GROUND.
[RULE 1403]
2. FOR EACH COMMERCIAL ABATEMENT PROJECT, LOCATED MORE THAN 3 METERS (10 FEET) BUT LESS THAN 30 METERS (98 FEET) FROM ANY RESIDENTIAL ZONING, THE NEGATIVE AIR MACHINE(S) SHALL NOT EXHAUST MORE THAN A COMBINED TOTAL OF 4.8 MILLION CUBIC FEET OF AIR (THE TOTAL RATED AIR FLOW OF ALL MACHINE(S) IN CUBIC FEET PER MINUTE MULTIPLIED BY THE TOTAL NUMBER OF WORKING HOURS INVOLVING ASBESTOS REMOVAL).
[RULE 1403]
3. FOR EACH COMMERCIAL ABATEMENT PROJECT, LOCATED GREATER THAN OR EQUAL TO 30 METERS (98 FEET) FROM ANY RESIDENTIAL ZONING, THE NEGATIVE AIR MACHINE(S) SHALL NOT EXHAUST AIR IN WHICH THE COMBINED TOTAL AIR VOLUME (THE TOTAL RATED AIR FLOW OF ALL MACHINE(S) IN CUBIC FEET PER MINUTE MULTIPLIED BY THE TOTAL NUMBER OF WORKING HOURS INVOLVING ASBESTOS REMOVAL) WILL EXCEED THE AMOUNT SPECIFIED ON TABLE 1.
[RULE 1403]

Emissions And Requirements:

4. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES AND REGULATION:

ASBESTOS: RULE 1403



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

RULE 219 EQUIPMENT

Equipment Description:

RULE 219 EXEMPT EQUIPMENT, COATING EQUIPMENT AND CONTROL ENCLOSURES USED
EXCLUSIVELY FOR EDUCATIONAL PURPOSES.

Emissions And Requirements:

1. THIS EQUIPMENT IS SUBJECT TO THE APPLICABLE REQUIREMENTS OF THE FOLLOWING RULES
AND REGULATIONS:

VOC: RULE 1171, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 1107, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 1136, SEE APPENDIX B FOR EMISSION LIMITS
VOC: RULE 109



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

GENERAL PROVISIONS

1. This permit may be revised, revoked, reopened and reissued, or terminated for cause, or for failure to comply with regulatory requirements, permit terms, or conditions. [3004(a)(7)(C)]
2. This permit does not convey any property rights of any sort or any exclusive privilege. [3004(a)(7)(E)]

Permit Renewal and Expiration

3. (A) Except for solid waste incineration facilities subject to standards under section 129(e) of the Clean Air Act, this permit shall expire five years from the date that this Title V permit is issued. The operator's right to operate under this permit terminates at midnight on this date, unless the facility is protected by an application shield in accordance with Rule 3002(b), due to the filing of a timely and complete application for a Title V permit renewal, consistent with Rule 3003. [3004(a)(2), 3004(f)]

(B) A Title V permit for a solid waste incineration facility combusting municipal waste subject to standards under Section 129(e) of the Clean Air Act shall expire 12 years from the date of issuance unless such permit has been renewed pursuant to this regulation. These permits shall be reviewed by the Executive Officer at least every five years from the date of issuance. [3004(f)(2)]
4. To renew this permit, the operator shall submit to the Executive Officer an application for renewal at least 180 days, but not more than 545 days, prior to the expiration date of this permit. [3003(a)(6)]

Duty to Provide Information

5. The applicant for, or holder of, a Title V permit shall furnish, pursuant to Rule 3002(d) and (e), timely information and records to the Executive Officer or designee within a reasonable time as specified in writing by the Executive Officer or designee. [3004(a)(7)(F)]

Payment of Fees

6. The operator shall pay all required fees specified in Regulation III - Fees. [3004(a)(7)(G)]



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

Reopening for Cause

7. The Executive Officer will reopen and revise this permit if any of the following circumstances occur:
- (A) Additional regulatory requirements become applicable with a remaining permit term of three or more years. Reopening is not required if the effective date of the requirement is later than the expiration date of this permit, unless the permit or any of its terms and conditions has been extended pursuant to paragraph (f)(4) of Rule 3004.
 - (B) The Executive Officer or EPA Administrator determines that this permit contains a material mistake or that inaccurate statements were made in establishing the emissions standards or other terms or conditions of this permit.
 - (C) The Executive Officer or EPA Administrator determines that the permit must be revised or revoked to assure compliance with the applicable requirements. [3005(g)(1)]

COMPLIANCE PROVISIONS

8. The operator shall comply with all regulatory requirements, and all permit terms and conditions, except:
- (A) As provided for by the emergency provisions of condition no. 17 or condition no. 18, or
 - (B) As provided by an alternative operating condition granted pursuant to a federally approved (SIP-approved) Rule 518.2.

Any non-compliance with any federally enforceable permit condition constitutes a violation of the Federal Clean Air Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or revision; or denial of a permit renewal application. Non-compliance may also be grounds for civil or criminal penalties under the California State Health and Safety Code. [3004(a)(7)(A)]



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

9. The operator shall allow the Executive Officer or authorized representative, upon presentation of appropriate credentials to:
 - (A) Enter the operator's premises where emission-related activities are conducted, or records are kept under the conditions of this permit;
 - (B) Have access to and copy, at reasonable times, any records that must be kept under the conditions of the permit;
 - (C) Inspect at reasonable times, any facilities, equipment (including monitoring and air pollution control equipment), practices, or operations regulated or required under the permit; and
 - (D) Sample or monitor at reasonable times, substances or parameters for the purpose of assuring compliance with the facility permit or regulatory requirements.
[3004(a)(10)(B)]
10. All terms and conditions in this permit, including any provisions designed to limit a facility's potential to emit, are enforceable by the EPA Administrator and citizens under the federal Clean Air Act, unless the term or condition is designated as not federally enforceable. Each day during any portion of which a violation occurs is a separate offense. [3004(g)]
11. A challenge to any permit condition or requirement raised by EPA, the operator, or any other person, shall not invalidate or otherwise affect the remaining portions of this permit. [3007(b)]
12. The filing of any application for a permit revision, revocation, or termination, or a notification of planned changes or anticipated non-compliance does not stay any permit condition. [3004(a)(7)(D)]
13. It shall not be a defense for a person in an enforcement action, including those listed in Rule 3002(c)(2), that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit, except as provided for in "Emergency Provisions" of this section. [3004(a)(7)(H)]



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

14. The operator shall not build, erect, install, or use any equipment, the use of which, without resulting in a reduction in the total release of air contaminants to atmosphere, reduces or conceals an emission which would otherwise constitute a violation of Chapter 3 (commencing with Section 41700) of Part 4, of Division 26 of the California Health and Safety Code or of AQMD rules. This rule shall not apply to cases in which the only violation involved is of Section 41700 of the California Health and Safety Code, or Rule 402 of AQMD Rules. [408]
15. Nothing in this permit or in any permit shield can alter or affect:
- (A) Under Section 303 of the federal Clean Air Act, the provisions for emergency orders;
 - (B) The liability of the operator for any violation of applicable requirements prior to or at the time of permit issuance;
 - (C) The applicable requirements of the Acid Rain Program, Regulation XXXI;
 - (D) The ability of EPA to obtain information from the operator pursuant to Section 114 of the federal Clean Air Act;
 - (E) The applicability of state or local requirements that are not "applicable requirements", as defined in Rule 3000, at the time of permit issuance but which do apply to the facility, such as toxics requirements unique to the State; and
 - (F) The applicability of regulatory requirements with compliance dates after the permit issuance date. [3004(c)(3)]
16. For any portable equipment that requires an AQMD or state permit or registration, excluding a) portable engines, b) military tactical support equipment and c) AQMD-permitted portable equipment that are not a major source, are not located at the facility for more than 12 consecutive months after commencing operation, and whose operation does not conflict with the terms or conditions of this Title V permit: 1) the facility operator shall keep a copy of the AQMD or state permit or registration; 2) the equipment operator shall comply with the conditions on the permit or registration and all other regulatory requirements; and 3) the facility operator shall treat the permit or registration as a part of its Title V permit, subject to recordkeeping, reporting and certification requirements. [3004(a)(1)]



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration EMERGENCY PROVISIONS

17. An emergency¹ constitutes an affirmative defense to an action brought for noncompliance with a technology-based emission limit only if:

(A) Properly signed, contemporaneous operating records or other credible evidence demonstrate that:

(1) An emergency occurred and the operator can identify the cause(s) of the emergency;

(2) The facility was operated properly (i.e. operated and maintained in accordance with the manufacturer's specifications, and in compliance with all regulatory requirements or a compliance plan), before the emergency occurred;

(3) The operator took all reasonable steps to minimize levels of emissions that exceeded emissions standard, or other requirements in the permit; and,

(4) The operator submitted a written notice of the emergency to the AQMD within two working days of the time when the emissions limitations were exceeded due to the emergency. The notice shall contain a description of the emergency, any steps taken to mitigate emissions, and corrective actions taken; and

(B) The operator complies with the breakdown provisions of Rule 430 – Breakdown Provisions, or subdivision (i) of Rule 2004 – Requirements, whichever is applicable. [3002(g), 430, 2004(i)]

18. The operator is excused from complying with any regulatory requirement that is suspended by the Executive Officer during a state of emergency or state of war emergency, in accordance with Rule 118 - Emergencies. [118]

¹ "Emergency" means any situation arising from sudden and reasonably unforeseeable events beyond the control of the operator, including acts of God, which: (A) requires immediate corrective action to restore normal operation; and (B) causes the facility to exceed a technology-based emission limitation under the permit, due to unavoidable increases in emissions attributable to the emergency; and (C) is not caused by improperly designed equipment, lack of preventative maintenance, careless or improper operation, or operator error.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration RECORDKEEPING PROVISIONS

19. In addition to any other recordkeeping requirements specified elsewhere in this permit, the operator shall keep records of required monitoring information, where applicable, that include:
- (A) The date, place as defined in the Title V permit, and time of sampling or measurements;
 - (B) The date(s) analyses were performed;
 - (C) The company or entity that performed the analyses;
 - (D) The analytical techniques or methods used;
 - (E) The results of such analyses; and
 - (F) The operating conditions as existing at the time of sampling or measurement. [3004(a)(4)(B)]
20. The operator shall maintain records pursuant to Rule 109 and any applicable material safety data sheet (MSDS) for any equipment claimed to be exempt from a written permit by Rule 219 based on the information in those records. [219(t)]
21. The operator shall keep all records of monitoring data required by this permit or by regulatory requirements for a period of at least five years from the date of the monitoring sample, measurement, report, or application. [3004(a)(4)(E)]

REPORTING PROVISIONS

22. The operator shall comply with the following requirements for prompt reporting of deviations:
- (A) Breakdowns shall be reported as required by Rule 430 – Breakdown Provisions or subdivision (i) of Rule 2004 - Requirements, whichever is applicable.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

- (B) Other deviations from permit or applicable rule emission limitations, equipment operating conditions, or work practice standards, determined by observation or by any monitoring or testing required by the permit or applicable rules that result in emissions greater than those allowed by the permit or applicable rules shall be reported within 72 hours (unless a shorter reporting period is specified in an applicable State or Federal Regulation) of discovery of the deviation by contacting AQMD enforcement personnel assigned to this facility or otherwise calling (800) CUT-SMOG.
 - (C) A written report of such deviations reported pursuant to (B), and any corrective actions or preventative measures taken, shall be submitted to AQMD, in an AQMD approved format, within 14 days of discovery of the deviation.
 - (D) All other deviations shall be reported with the monitoring report required by condition no. 23. [3004(a)(5)]
23. Unless more frequent reporting of monitoring results are specified in other permit conditions or in regulatory requirements, the operator shall submit reports of any required monitoring to the AQMD at least twice per year. The report shall include a) a statement whether all monitoring required by the permit was conducted; and b) identification of all instances of deviations from permit or regulatory requirements. A report for the first six calendar months of the year is due by August 31 and a report for the last six calendar months of the year is due by February 28. [3004(a)(4)(F)]
24. The operator shall submit to the Executive Officer and to the Environmental Protection Agency (EPA), an annual compliance certification. For RECLAIM facilities, the certification is due when the Annual Permit Emissions Program (APEP) report is due and shall cover the same reporting period. For other facilities, the certification is due on March 1 for the previous calendar year. The certification need not include the period preceding the date the initial Title V permit was issued. Each compliance certification shall include:
- (A) Identification of each permit term or condition that is the basis of the certification;



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

- (B) The compliance status during the reporting period;
- (C) Whether compliance was continuous or intermittent;
- (D) The method(s) used to determine compliance over the reporting period and currently, and
- (E) Any other facts specifically required by the Executive Officer to determine compliance.

The EPA copy of the certification shall be sent to: Director of the Air Division Attn:
Air-3 USEPA, Region IX 75 Hawthorne St. San Francisco, CA 94105 [3004(a)(10)(E)]

25. All records, reports, and documents required to be submitted by a Title V operator to AQMD or EPA shall contain a certification of accuracy consistent with Rule 3003(c)(7) by a responsible official (as defined in Rule 3000). [3004(a)(12)]

PERIODIC MONITORING

26. All periodic monitoring required by this permit pursuant to Rule 3004(a)(4)(c) is based on the requirements and justifications in the AQMD document "Periodic Monitoring Guidelines for Title V Facilities" or in case-by-case determinations documented in the TitleV application file. [3004(a)(4)]



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

FACILITY RULES

This facility is subject to the following rules and regulations

With the exception of Rule 402, 473, 477, 1118 and Rules 1401 through 1420, the following rules that are designated as non-federally enforceable are pending EPA approval as part of the state implementation plan. Upon the effective date of that approval, the approved rule(s) will become federally enforceable, and any earlier versions of those rules will no longer be federally enforceable.

RULE SOURCE	Adopted/Amended Date	FEDERAL Enforceability
RULE 1107	1-6-2006	Non federally enforceable
RULE 1107	11-9-2001	Federally enforceable
RULE 1113	11-8-1996	Federally enforceable
RULE 1113	7-13-2007	Non federally enforceable
RULE 1130	10-8-1999	Federally enforceable
RULE 1130.1	12-13-1996	Federally enforceable
RULE 1134	8-8-1997	Federally enforceable
RULE 1136	6-14-1996	Federally enforceable
RULE 1140	2-1-1980	Federally enforceable
RULE 1140	8-2-1985	Non federally enforceable
RULE 1145	12-3-2004	Non federally enforceable
RULE 1145	2-14-1997	Federally enforceable
RULE 1146	11-17-2000	Federally enforceable
RULE 1146	9-5-2008	Non federally enforceable
RULE 1146.1	5-13-1994	Federally enforceable
RULE 1146.1	9-5-2008	Non federally enforceable
RULE 1146.2	5-5-2006	Federally enforceable
RULE 1170	5-6-1988	Non federally enforceable
RULE 1171	11-7-2003	Federally enforceable
RULE 1171	2-1-2008	Non federally enforceable
RULE 1171	5-1-2009	Non federally enforceable
RULE 1303(a)(1)-BACT	12-6-2002	Non federally enforceable



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

RULE SOURCE	Adopted/Amended Date	FEDERAL Enforceability
RULE 1303(a)(1)-BACT	5-10-1996	Federally enforceable
RULE 1303(b)(2)-Offset	12-6-2002	Non federally enforceable
RULE 1303(b)(2)-Offset	5-10-1996	Federally enforceable
RULE 1304(a)-Modeling and Offset Exemption	6-14-1996	Federally enforceable
RULE 1401	3-7-2008	Non federally enforceable
RULE 1403	10-5-2007	Non federally enforceable
RULE 1404	4-6-1990	Non federally enforceable
RULE 1415	10-14-1994	Non federally enforceable
RULE 1418	9-10-1999	Non federally enforceable
RULE 1470	6-1-2007	Non federally enforceable
RULE 1472	3-7-2008	Non federally enforceable
RULE 204	10-8-1993	Federally enforceable
RULE 217	1-5-1990	Federally enforceable
RULE 218	5-14-1999	Federally enforceable
RULE 218	8-7-1981	Federally enforceable
RULE 219	6-1-2007	Non federally enforceable
RULE 219	9-4-1981	Federally enforceable
RULE 3004	12-12-1997	Federally enforceable
RULE 3007	10-8-1993	Federally enforceable
RULE 304	6-5-2009	Non federally enforceable
RULE 402	5-7-1976	Non federally enforceable
RULE 404	2-7-1986	Federally enforceable
RULE 405	2-7-1986	Federally enforceable
RULE 407	4-2-1982	Federally enforceable
RULE 408	5-7-1976	Federally enforceable
RULE 409	8-7-1981	Federally enforceable
RULE 429	12-21-1990	Non federally enforceable
RULE 430	7-12-1996	Non federally enforceable
RULE 431.1	6-12-1998	Federally enforceable
RULE 431.2	5-4-1990	Federally enforceable
RULE 431.2	9-15-2000	Non federally enforceable
RULE 461	3-7-2008	Non federally enforceable



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

SECTION K: TITLE V Administration

RULE SOURCE	Adopted/Amended Date	FEDERAL Enforceability
RULE 461	6-3-2005	Federally enforceable
RULE 475	10-8-1976	Federally enforceable
RULE 475	8-7-1978	Non federally enforceable
RULE 476	10-8-1976	Federally enforceable
RULE 481	1-11-2002	Federally enforceable
RULE 701	6-13-1997	Federally enforceable
40CFR 60 Subpart GG	2-24-2006	Federally enforceable
40CFR 82 Subpart B	7-14-1992	Federally enforceable
40CFR 82 Subpart F	5-14-1993	Federally enforceable



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1107 01-06-2006]

Except as otherwise provided in Rule 1107

(1) VOC Content of Coatings

A person shall not apply to metal parts and products subject to the provisions of this rule any coatings, including any VOC-containing materials added to the original coating supplied by the manufacturer, which contain VOC in excess of the limits specified below:

VOC LIMITS Less Water and Less Exempt Compounds Effective Dates								
Coating	Air-Dried				Baked			
	gm/l		lb/gal		gm/l		lb/gal	
	Current	7/1/07	Current	7/1/07	Current	7/1/07	Current	7/1/07
General One-Component	275	275	2.3	2.3	275	275	2.3	2.3
General Multi-Component	340	340	2.8	2.8	275	275	2.3	2.3
Military Specification	340	340	2.8	2.8	275	275	2.3	2.3
Etching Filler	420	420	3.5	3.5	420	420	3.5	3.5
Solar-Absorbent	420	420	3.5	3.5	360	360	3.0	3.0
Heat-Resistant	420	420	3.5	3.5	360	360	3.0	3.0
Extreme High-Gloss	420	340	3.5	2.8	360	360	3.0	3.0
Metallic	420	420	3.5	3.5	420	420	3.5	3.5



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1107 01-06-2006]**

VOC LIMITS								
Less Water and Less Exempt Compounds								
Effective Dates, cont.								
Coating	Air-Dried				Baked			
	gm/l		lb/gal		gm/l		lb/gal	
	Current	7/1/07	Current	7/1/07	Current	7/1/07	Current	7/1/07
Extreme Performance	420	420	3.5	3.5	360	360	3.0	3.0
Prefabricated Architectural One-Component	420	275	3.5	2.3	275	275	2.3	2.3
Prefabricated Architectural Multi-Component	420	340	3.5	2.8	275	275	2.3	2.3
Touch Up	420	420	3.5	3.5	360	360	3.0	3.0
Repair	420	420	3.5	3.5	360	360	3.0	3.0
Silicone Release	420	420	3.5	3.5	420	420	3.5	3.5
High-Performance Architectural	420	420	3.5	3.5	420	420	3.5	3.5
Camouflage	420	420	3.5	3.5	420	420	3.5	3.5
Vacuum-Metalizing	420	420	3.5	3.5	420	420	3.5	3.5
Mold-Seal	420	420	3.5	3.5	420	420	3.5	3.5
High-Temperature	420	420	3.5	3.5	420	420	3.5	3.5
Electric-Insulating Varnish	420	420	3.5	3.5	420	420	3.5	3.5
Pan Backing	420	420	3.5	3.5	420	420	3.5	3.5
Pretreatment Coatings	420	420	3.5	3.5	420	420	3.5	3.5



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1107 01-06-2006]**

- (2) A person shall not use VOC-containing materials which have a VOC content of more than 200 grams per liter of material for stripping any coating governed by this rule.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1107 11-09-2001]

Except as otherwise provided in Rule 1107

(1) VOC Content of Coatings

A person shall not apply to metal parts and products subject to the provisions of this rule any coatings, including any VOC-containing materials added to the original coating supplied by the manufacturer, which contain VOC in excess of the limits specified below:

VOC LIMITS Less Water and Less Exempt Compounds Effective Dates								
Coating	Air-Dried				Baked			
	gm/l		lb/gal		gm/l		lb/gal	
	Current	7/1/07	Current	7/1/07	Current	7/1/07	Current	7/1/07
General One-Component	275	275	2.3	2.3	275	275	2.3	2.3
General Multi-Component	340	340	2.8	2.8	275	275	2.3	2.3
Military Specification	340	340	2.8	2.8	275	275	2.3	2.3
Etching Filler	420	420	3.5	3.5	420	420	3.5	3.5
Solar-Absorbent	420	420	3.5	3.5	360	360	3.0	3.0
Heat-Resistant	420	420	3.5	3.5	360	360	3.0	3.0
Extreme High-Gloss	420	340	3.5	2.8	360	360	3.0	3.0
Metallic	420	420	3.5	3.5	420	420	3.5	3.5



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1107 11-09-2001]**

Except as otherwise provided in Rule 1107

(1) VOC Content of Coatings

A person shall not apply to metal parts and products subject to the provisions of this rule any coatings, including any VOC-containing materials added to the original coating supplied by the manufacturer, which contain VOC in excess of the limits specified below:

VOC LIMITS								
Less Water and Less Exempt Compounds								
Effective Dates								
Coating	Air-Dried				Baked			
	gm/l		lb/gal		gm/l		lb/gal	
	Current	7/1/07	Current	7/1/07	Current	7/1/07	Current	7/1/07
General One-Component	275	275	2.3	2.3	275	275	2.3	2.3
General Multi-Component	340	340	2.8	2.8	275	275	2.3	2.3
Military Specification	340	340	2.8	2.8	275	275	2.3	2.3
Etching Filler	420	420	3.5	3.5	420	420	3.5	3.5
Solar-Absorbent	420	420	3.5	3.5	360	360	3.0	3.0
Heat-Resistant	420	420	3.5	3.5	360	360	3.0	3.0
Extreme High-Gloss	420	340	3.5	2.8	360	360	3.0	3.0
Metallic	420	420	3.5	3.5	420	420	3.5	3.5



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1107 11-09-2001]**

VOC LIMITS								
Less Water and Less Exempt Compounds								
Effective Dates, cont.								
Coating	Air-Dried				Baked			
	gm/l		lb/gal		gm/l		lb/gal	
	Cur rent	7/1/07	Current	7/1/07	Current	7/1/07	Current	7/1/07
Extreme Performance	420	420	3.5	3.5	360	360	3.0	3.0
Prefabricated Architectural One-Component	420	275	3.5	2.3	275	275	2.3	2.3
Prefabricated Architectural Multi-Component	420	340	3.5	2.8	275	275	2.3	2.3
Touch Up	420	420	3.5	3.5	360	360	3.0	3.0
Repair	420	420	3.5	3.5	360	360	3.0	3.0
Silicone Release	420	420	3.5	3.5	420	420	3.5	3.5
High-Performance Architectural	420	420	3.5	3.5	420	420	3.5	3.5
Camouflage	420	420	3.5	3.5	420	420	3.5	3.5
Vacuum-Metalizing	420	420	3.5	3.5	420	420	3.5	3.5
Mold-Seal	420	420	3.5	3.5	420	420	3.5	3.5
High-Temperature	420	420	3.5	3.5	420	420	3.5	3.5
Electric-Insulating Varnish	420	420	3.5	3.5	420	420	3.5	3.5
Pan Backing	420	420	3.5	3.5	420	420	3.5	3.5
Pretreatment Coatings	420	420	3.5	3.5	420	420	3.5	3.5

- (2) A person shall not use VOC-containing materials which have a VOC content of more than 200 grams per liter of material for stripping any coating governed by this rule.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS

[RULE 1113 11-08-1996]

- (1) Except as provided in paragraphs (c)(2), (c)(3), and (c)(4) of Rule 1113, the operator shall not supply, sell, offer for sale, apply, or solicit the application of, any architectural coating which, at the time of sale or manufacture, contains more than 250 grams of VOC per liter of coating (2.08 pounds per gallon), less water, less exempt compounds, and less any colorant added to tint bases, or manufacture, blend, or repackage such a coating for use within the District.
- (2) Except as provided in paragraphs (c)(3) and (c)(4) of Rule 1113, the operator shall not supply, sell, offer for sale, apply, solicit the application of, manufacture, blend, or repackage, for use within the District, any architectural coating listed in the Table of Standards which contains VOC (excluding any colorant added to tint bases) in excess of the corresponding VOC limit specified in the table, after the effective date specified.

TABLE OF STANDARDS

VOC LIMITS

Grams of VOC Per Liter of Coating, Less Water And Less Exempt Compounds

COATING	Limit*	Effective Date of Adoption	Effective 1/1/1998	Effective 1/1/1999	Effective 7/1/2001	Effective 1/1/2005	Effective 7/1/2008
Bond Breakers	350						
Clear Wood Finishes							
Varnish	350						
Sanding Sealers	350						
Lacquer	680		550			275	
Concrete-Curing Compounds	350						
Dry-Fog Coatings	400						
Fire-proofing Exterior	350	450		350			
Coatings							
Fire-Retardant Coatings							
Clear	650						
Pigmented	350						
Flats	250					100	50
Graphic Arts (Sign) Coatings	500						



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS

[RULE 1113 11-08-1996]

Industrial Maintenance							
Primers and Topcoats							
Alkyds	420						
Catalyzed Epoxy	420						
Bituminous Coatings	420						
Materials							
Inorganic Polymers	420						
Vinyl Chloride Polymers	420						
Chlorinated Rubber	420						
Acrylic Polymers	420						
Urethane Polymers	420						
Silicones	420						
Unique Vehicles	420						
Japans/Faux Finishing	350	700		350			
Coatings							
Magnesite Cement Coatings	600			450			
Mastic Coatings	300						
Metallic Pigmented Coatings	500						
Multi-Color Coatings	420		250			275	
Pigmented Lacquer	680		550				
Pre-Treatment Wash Primers	780						
Primers, Sealers, and	350						
Undercoaters							
Quick-Dry Enamels	400						
Roof Coatings	300						
Shellac							
Clear	730						
Pigmented	550						
Stains	350						
Swimming Pool Coatings							
Repair	650						
Other	340						
Traffic Coatings	250		150				
Waterproofing Sealers	400						
Wood Preservatives							
Below-Ground	350						
Other	350						

* The specified limits remain in effect unless revised limits are listed in subsequent columns in the Table of Standards

TABLE OF STANDARDS (cont.)

VOC LIMITS

Grams of VOC Per Liter of Material

COATING	Limit
Low-Solids Coating	120



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 07-13-2007]

- (1) Except as provided in paragraphs (c)(2), (c)(3), (c)(4), and specified coatings averaged under (c)(6), no person shall supply, sell, offer for sale, manufacture, blend, or repackage any architectural coating for use in the District which, at the time of sale or manufacture, contains more than 250 grams of VOC per liter of coating (2.08 pounds per gallon), less water, less exempt compounds, and less any colorant added to tint bases, and no person shall apply or solicit the application of any architectural coating within the District that exceeds 250 grams of VOC per liter of coating as calculated in this paragraph.
- (2) Except as provided in paragraphs (c)(3), (c)(4), and designated coatings averaged under (c)(6), no person shall supply, sell, offer for sale, manufacture, blend, or repackage, for use within the District, any architectural coating listed in the Table of Standards which contains VOC (excluding any colorant added to tint bases) in excess of the corresponding VOC limit specified in the table, after the effective date specified, and no person shall apply or solicit the application of any architectural coating within the District that exceeds the VOC limit as specified in this paragraph. No person shall apply or solicit the application within the District of any industrial maintenance coatings, except anti-graffiti coatings, for residential use or for use in areas such as office space and meeting rooms of industrial, commercial or institutional facilities not exposed to such extreme environmental conditions described in the definition of industrial maintenance coatings; or of any rust-preventative coating for industrial use, unless such a rust preventative coating complies with the Industrial Maintenance Coating VOC limit specified in the Table of Standards.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 07-13-2007]

TABLE OF STANDARDS VOC LIMITS

Grams of VOC Per Liter of Coating,
Less Water and Less Exempt Compounds

COATING CATEGORY	Ceiling Limit*	Current Limit	Effective Date					
			1/1/03	1/1/04	1/1/05	7/1/06	7/1/07	7/1/08
Bond Breakers	350							
Clear Wood Finishes	350					275		
Varnish	350					275		
Sanding Sealers	350					275		
Lacquer	680	550			275			
Clear Brushing Lacquer	680				275			
Concrete-Curing Compounds	350						100	
Concrete-Curing Compounds For Roadways and Bridges**	350							
Dry-Fog Coatings	400						150	
Fire-Proofing Exterior Coatings	450	350						
Fire-Retardant Coatings***								
Clear	650							
Pigmented	350							
Flats	250	100						50
Floor Coatings	420		100			50		
Graphic Arts (Sign) Coatings	500							
Industrial Maintenance (IM) Coatings	420			250		100		
High Temperature IM Coatings			420					
Zinc-Rich IM Primers	420		340			100		
Japans/Faux Finishing Coatings	700	350						
Magnesite Cement Coatings	600	450						
Mastic Coatings	300							
Metallic Pigmented Coatings	500							
Multi-Color Coatings	420	250						
Nonflat Coatings	250		150			50		



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1113 07-13-2007]

COATING CATEGORY	Ceiling Limit*	Current Limit	Effective Date					
			1/1/03	1/1/04	1/1/05	7/1/06	7/1/07	7/1/08
Nonflat High Gloss	250		150				50	
Pigmented Lacquer	680	550			275			
Pre-Treatment Wash Primers	780		420					
Primers, Sealers, and Undercoaters	350		200			100		
Quick-Dry Enamels	400		250			150	50	
Quick-Dry Primers, Sealers, and Undercoaters	350		200			100		
Recycled Coatings			250					
Roof Coatings	300		250		50			
Roof Coatings, Aluminum	500				100			
Roof Primers, Bituminous	350		350					
Rust Preventative Coatings	420		400			100		
Shellac								
Clear	730							
Pigmented	550							
Specialty Primers	350					250	100	
Stains	350		250				100	
Stains, Interior	250							
Swimming Pool Coatings								
Repair	650		340					
Other	340							
Traffic Coatings	250	150					100	
Waterproofing Sealers	400		250			100		
Waterproofing	400					100		
Concrete/Masonry Sealers								
Wood Preservatives								
Below-Ground	350							
Other	350							

* The specified limits remain in effect unless revised limits are listed in subsequent columns in the Table of Standards.

** Does not include compounds used for curbs and gutters, sidewalks, islands, driveways and other miscellaneous concrete areas.

*** The Fire-Retardant Coating category will be eliminated on January 1, 2007 and subsumed by the coating category for which they are formulated.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1113 07-13-2007]**


**TABLE OF STANDARDS (cont.)
VOC LIMITS**

Grams of VOC Per Liter of Material

COATING	Limit
Low-Solids Coating	120



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

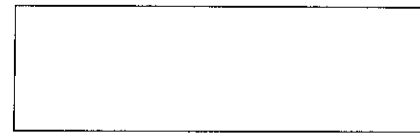



**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1130 10-08-1999]**

(Amended October 8, 1999)

RULE 1130. GRAPHIC ARTS

Except as otherwise provided in Rule 1130

(1) VOC Content of Graphic Arts Materials

The operator shall not apply any graphic arts material, including any VOC-containing materials added to the original graphic arts materials, which contains a total VOC in excess of the limits specified below:

<u>GRAPHIC ARTS MATERIAL</u>	VOC LIMIT Grams per Liter of Coating (or Ink or Adhesive), Less Water and Less Exempt Compounds	
	<u>(October 8, 1999)</u>	<u>Effective January 1, 2000</u>
Lithographic Ink	300	300
Letterpress Ink	300	300
Gravure Ink	300	300
Flexographic Ink Non-Porous Substrate	300	300
Flexographic Ink Porous Substrate	300	225
Flexographic Fluorescent Ink	300	300
Coating	300	300
Adhesive	300	150



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1130 10-08-1999]**


(2) VOC Content of Fountain Solution

Through December 31, 1999, the operator shall not apply in any graphic arts operation any fountain solution, including any VOC-containing materials added to the original fountain solution, which contains a total VOC in excess of 100 grams per liter of material. Effective January 1, 2000, the VOC content of fountain solution, including any VOC containing material added to the original fountain solution as applied, shall be:

- (A) no greater than 80 grams per liter of material, or
- (B) no greater than 100 grams per liter of material, if a refrigerated chiller is used.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

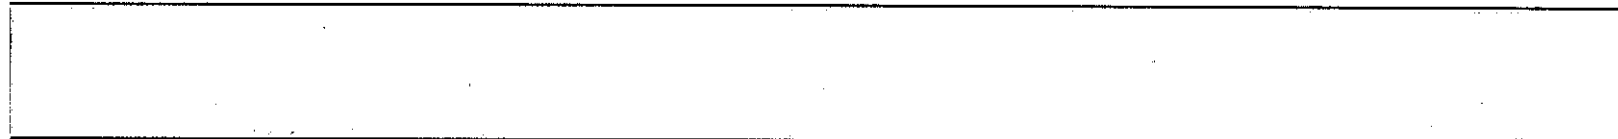



FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1130.1 12-13-1996]

Except as otherwise provided in Rule 1130.1

(1) **VOC Content of Screen Printing Materials**

The operator shall not apply to any substrate any screen printing material, excluding extreme performance screen printing materials, which contains, as applied, a total amount of VOC in excess of the limits specified in subparagraphs (1)(A), (1)(B), or (1)(C). The applicable VOC limit for a screen printing operation shall be determined by first looking for the product in subparagraph (1)(A). If the product is not listed in subparagraph (1)(A), look for the product's substrate in subparagraph (1)(B). If the substrate is not listed in subparagraph (1)(B), look for the applicable limit in subparagraph (1)(C).

In lieu of meeting the requirements in subparagraph (1)(C), the operator may comply with the requirements in paragraph (2) if the screen printing material qualifies for an extreme performance classification under subdivision (e) of Rule 1130.1.

- (A) For screen printing coatings and inks used in the production of the following products:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1130.1 12-13-1996]

VOC LIMIT

grams per Liter of
Coating

PRODUCT

(or Ink), Less water and
Less Exempt
Compounds

On and After
December 13, 1996

	<u>g/L-</u>	<u>lbs/gal-</u>
Chlorine Indicator	500	4.2
Containers	800	6.7
Electronic Circuit	850	7.1
Mechanically- Formed Products	800	6.7
Overlays	800	6.7
Polyethylene	800	6.7
Products		
Stained Glass	800	6.7
Overlay		
Sterilization Indicator	600	5.0
Sub-Printed Products	800	6.7
Water Slide Decals:		
Opaque Inks	800	6.7
Clear Inks	800	6.7
Ceramic Decal	800	6.7
Inks		

- (B) For screen printing coatings and inks not regulated by subparagraph (1)(A) and which are applied to the following specified substrates:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1130.1 12-13-1996]

VOC LIMIT

grams per Liter of Coating
(or Ink), Less water
and Less Exempt
Compounds

SUBSTRATE

On and After
December 13, 1996

	<u>g/L</u>	<u>lbs/gal</u>
Ceramic	800	6.7
Fiberglass	600	5.0
Glass or Metal	600	5.0
Man-Made Textile	800	6.7
Unsealed Aluminum	800	6.7

If a substrate is regulated under more than one substrate category listed in subparagraph (1)(B), the category with the highest VOC limit shall apply.

- (C) For screen printing materials not regulated by the provisions in subparagraph (1)(A) or (1)(B), which have the following material classifications:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1130.1 12-13-1996]

<u>SCREEN PRINTING MATERIAL</u>	<u>VOC LIMIT</u> grams per Liter of Coating (or Ink or Adhesive), Less water and Less Exempt Compounds	
	On and After December 13, 1996	
	<u>g/L</u>	<u>lbs/gal</u>
Adhesive	400	3.3
Coating	400	3.3
Fine Detail Loose-leaf Binder Ink	745	6.2
Fluorescent Ink	540	4.5
High-VOC Serigraph Ink	800	6.7
Loose-leaf Binder Metallic Ink	745	6.2
Metallic Ink	400	3.3
Printing Ink	400	3.3
Resists	600	5.0
Scratch-Off Ink	800	6.7
Water-Slide Decal Adhesive	800	6.7

If a screen printing material is regulated under more than one screen printing material category listed in subparagraph (1)(C), the category with the highest VOC limit shall apply.

(2) VOC Content of Extreme Performance Screen Printing Materials

The operator shall not apply any extreme performance screen printing material in excess of the limits specified below:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1130.1 12-13-1996]

VOC LIMIT

Grams of VOC per Liter of
Extreme Performance Screen
Printing Material, Less Water and
Less Exempt Compounds

	<u>g/L</u>	<u>lbs/gal</u>
On and after July 9, 1993	800	6.7
On and after January 1, 2003	400	3.3

(3) Usage of High-VOC Serigraph Inks

The total usage of high-VOC serigraph inks, as defined in paragraph (b)(23) of Rule 1130.1, shall not exceed 10 percent, (by volume), of the total usage of screen printing materials applied on all serigraphs at a facility, on a monthly basis, unless an approved emission control system is used to reduce emissions from high-VOC serigraph inks by an equivalent or greater level to that which would have been achieved by the use of an ink containing 3.3 pounds per gallon VOC (less water and exempt compounds). The required overall control efficiency of the emission control system shall be determined by the equation in paragraph (d)(1) of Rule 1130.1.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1136 06-14-1996]

Except as otherwise provided in Rule 1136

- (a) The operator shall not apply any coating to a wood product which has a VOC content, including any VOC-containing material added to the original coating supplied by the manufacturer, which exceeds the applicable limit specified below:

(1)

VOC LIMITS

Grams Per Liter (lb/gal) of Coating, [lbs VOC/lb of solids],
Less Water and Less Exempt Compounds

<u>COATING</u>	<u>Current Limit</u>		<u>On and After</u>
	<u>I</u>	<u>or</u> <u>II</u>	<u>7/1/2005</u>
Clear Sealers	550 (4.6) [1.39]	680 (5.7) [3.36]	275 (2.3) [0.36]
Clear Topcoat	550 (4.6) [1.37]	275 (2.3) [0.35]	275 (2.3) [0.35]
Pigmented Primers, Sealers & Undercoats	550 (4.6) [1.06]	600 (5.0) [1.08]	275 (2.3) [0.21]
Pigmented Topcoats	550 (4.6) [1.10]	275 (2.3) [0.25]	275 (2.3) [0.25]

The operator shall use coatings on a wood product that comply with either all VOC limits in column I or all VOC limits in column II. The operator that applies a primer, sealer or undercoat, but not a topcoat, to a wood product, shall be subject to column I for that wood product.

- (2) Notwithstanding the requirements of clause (a)(1), an operator that applies a topcoat and a primer, sealer or undercoat to a shutter may, until July 1, 2005, choose to comply with the VOC limits specified below for that shutter:



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1136 06-14-1996]

VOC LIMITS

Grams Per Liter, (lb/gal) of Coating, [lbs VOC/lb of solids],
Less Water and Less Exempt Compounds

COATING

Clear Sealers	275 (2.3) [0.36]
Clear Topcoat	680 (5.7) [2.99]
Pigmented Primers, Sealers & Undercoats	275 (2.3) [0.33]
Pigmented Topcoats	600 (5.0) [1.38]

(3)

VOC LIMITS

Grams Per Liter, (lb/gal) of Coating, [lbs VOC/lb of solids],
Less Water and Less Exempt Compounds

On and After

COATING

	<u>Current Limit</u>	<u>7/1/2005</u>
Barrier Coat - Plastic Components	760 (6.3) [3.9]	275 (2.3) [0.28]
Composite Wood Edge Filler	550 (4.6) [1.15]	275 (2.3) [0.31]
Extreme Performance Coatings	420 (3.5) [0.51]	275 (2.3) [0.33]
Fillers	500 (4.2) [0.66]	275 (2.3) [0.18]
High-Solid Stains	550 (4.6) [1.23]	350 (2.9) [0.42]
Inks	500 (4.2) [0.96]	500 (4.2) [0.96]
Mold-Seal Coatings	750 (6.3) [4.2]	750 (6.3) [4.2]
Multi-Colored Coatings	685 (5.7) [2.6]	275 (2.3) [0.33]

VOC LIMITS

Grams Per Liter (lb/gal) of Material

On and After

COATING

	<u>Current Limit</u>	<u>7/1/2005</u>
Low-Solids Barrier Coat - Plastic Components	760 (6.3)	120 (1.0)
Low-Solid Stains, Toners, and Washcoats	480 (4.0)	120 (1.0)



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1136 06-14-1996]**

Any coating subject to this rule that meets any of the three VOC limit formats (grams per liter, lb/gal, or lbs VOC/lb of solids) is in compliance with this subparagraph.

- (4) The VOC limit for japan coatings is 700 grams per liter of coatings, less water and exempt compounds, as applied.
- (b) A person shall not use a stripper on wood products unless:
 - (1) it contains less than 350 grams of VOC per liter of material; or
 - (2) the VOC composite vapor pressure is 2 mm Hg (0.04 psia) or less at 20°C (68°F).



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS

[RULE 1140 02-01-1980]

- (1) The operator shall not, if he complies with an applicable performance standard in section (b)(4) of Rule 1140, discharge into the atmosphere from any abrasive blasting any air contaminant for a period or periods aggregating more than three minutes in any one hour which is:
 - (A) As dark or darker in shade as that designated as No. 2 on the Ringelmann Chart, as published by the United States Bureau of Mines, or
 - (B) Of such opacity as to obscure an observer's view to a degree equal to or greater than does smoke described in (1)(A).
- (2) The operator shall not, if he is not complying with an applicable performance standard in section (b)(4) of Rule 1140, discharge into the atmosphere from any abrasive blasting any air contaminant for a period or periods aggregating more than three minutes in any one hour which is:
 - (A) As dark or darker in shade as that designated as No. 1 on the Ringelmann Chart, as published by the United States Bureau of Mines, or
 - (B) Of such opacity as to obscure an observer's view to a degree equal to or greater than does smoke described in (2)(A).



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1140 08-02-1985]

- (1) The operator shall not, if he complies with an applicable performance standard in section (b)(4) of Rule 1140, discharge into the atmosphere from any abrasive blasting any air contaminant for a period or periods aggregating more than three minutes in any one hour which is:
 - (A) As dark or darker in shade as that designated as No. 2 on the Ringelmann Chart, as published by the United States Bureau of Mines, or
 - (B) Of such opacity as to obscure an observer's view to a degree equal to or greater than does smoke described in (1)(A).
- (2) The operator shall not, if he is not complying with an applicable performance standard in section (b)(4) of Rule 1140, discharge into the atmosphere from any abrasive blasting any air contaminant for a period or periods aggregating more than three minutes in any one hour which is:
 - (A) As dark or darker in shade as that designated as No. 1 on the Ringelmann Chart, as published by the United States Bureau of Mines, or
 - (B) Of such opacity as to obscure an observer's view to a degree equal to or greater than does smoke described in (2)(A).



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1145 12-03-2004]


A person shall not apply on plastics, glass, leather, or rubber any coatings which are applied with a VOC content in excess of the limits specified below:

COATING CATEGORIES	VOC Limits Less Water and Less Exempt Compounds Effective Dates									
	Current		Jan 1, 2005		Jan 1, 2006		Jan 1, 2007		Jan 1, 2008	
	g/L	lbs/gal	g/L	lbs/gal	g/L	lbs/gal	g/L	lbs/gal	g/L	lbs/gal
Electrical dissipating and shock free coatings	360	3.0								
Extreme performance two-component coatings	NA		NA		420	3.5				
General one-component coatings	275	2.3					120	1.0		
General two-component coatings	420	3.5			300	2.5			120	1.0
Leather antique coatings			156	1.3						
Leather color coatings			60	0.5						
Leather sealer coatings			60	0.5						
Leather stain coatings			216	1.8						
Leather top coatings			120	1.0						
Metallic coatings	420	3.5								
Military specification one-component coatings	340	2.8								
Military specification two-component coatings	420	3.5								
Mirror backing curtain coated coatings	500	4.2								
Mirror backing rolled coated coatings	430	3.6					312	2.6		
Mold seal coatings	750	6.3								
Multi-colored coatings	685	5.7								
Optical coatings	800	6.7					50	0.4		
Vacuum metalizing coatings	800	6.7								



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS

[RULE 1145 02-14-1997]

Except as otherwise provided in Rule 1145, the operator shall not apply on plastics, glass, or rubber any coatings which are applied with a VOC content in excess of the limits specified below:

COATING

VOC LIMITS Less Water and Less Exempt Compounds

	<u>Current</u>		<u>On and After 1-1-98</u>	
	<u>g/L</u>	<u>lbs/gal</u>	<u>g/L</u>	<u>lbs/gal</u>
General Coatings				
One-component	275	2.3	275	2.3
Two-component	420	3.5	420	3.5
Military Spec. Coating				
One-component	340	2.8	340	2.8
Two-component	420	3.5	420	3.5
Multi-Colored Coatings	685	5.7	685	5.7
Mold Seal Coatings	750	6.3	750	6.3
Vacuum Metalizing Coatings	800	6.7	800	6.7
Mirror Backing				
Curtain Coated	500	4.2	500	4.2
Roll Coated	430	3.6	430	3.6
Optical Coatings	800	6.7	800	6.7
Electric Dissipating Coatings and Shock-				
Free Coatings	800	6.7	360	3.0
Metallic Coatings	420	3.5	420	3.5



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1171 11-07-2003]

(1) Solvent Requirements

A person shall not use a solvent to perform solvent cleaning operations unless the solvent complies with the applicable requirements set forth below:

SOLVENT CLEANING ACTIVITY	CURRENT LIMITS
	VOC g/l (lb/gal)
(A) Product Cleaning During Manufacturing Process Or Surface Preparation For Coating, Adhesive, Or Ink Application	
(i) General	25 (0.21)
(ii) Electrical Apparatus Components & Electronic Components	500 (4.2)
(iii) Medical Devices & Pharmaceuticals	800 (6.7)
(B) Repair and Maintenance Cleaning	
(i) General	25 (0.21)
(ii) Electrical Apparatus Components & Electronic Components	900 (7.5)



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1171 11-07-2003]**

SOLVENT CLEANING ACTIVITY	CURRENT LIMITS
	VOC g/l (lb/gal)
(iii) Medical Devices & Pharmaceuticals	
(A) Tools, Equipment, & Machinery	800 (6.7)
(B) General Work Surfaces	600 (5.0)
(C) Cleaning of Coatings or Adhesives Application Equipment	550 (4.6)
(D) Cleaning of Ink Application Equipment	
(i) General	25 (0.21)
(ii) Flexographic Printing	25 (0.21)
(iii) Gravure Printing	
(A) Publication	750 (6.3)
(B) Packaging	25 (0.21)
(iv) Lithographic or Letter Press Printing	



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1171 11-07-2003]**

SOLVENT CLEANING ACTIVITY	CURRENT LIMITS
	VOC g/l (lb/gal)
(A) Roller Wash – Step 1	600 (5.0)
(B) Roller Wash-Step 2, Blanket Wash, & On-Press Components	800 (6.7)
(C) Removable Press Components	25 (0.21)
(v) Screen Printing	750 (6.3)
(vi) Ultraviolet Ink/ Electron Beam Ink Application Equipment (except screen printing)	800 (6.7)
(vii) Specialty Flexographic Printing	600 (5.0)
(E) Cleaning of Polyester Resin Application Equipment	25 (0.21)



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1171 05-01-2009]

(1) Solvent Requirements

A person shall not use a solvent to perform solvent cleaning operations unless the solvent complies with the applicable requirements set forth below:

	CURRENT LIMITS*	EFFECTIVE 1/1/2010
SOLVENT CLEANING ACTIVITY	VOC g/l (lb/gal)	VOC g/l (lb/gal)
(A) Product Cleaning During Manufacturing Process Or Surface Preparation For Coating, Adhesive, Or Ink Application		
(i) General	25 (0.21)	
(ii) Electrical Apparatus Components & Electronic Components	100 (0.83)	
(iii) Medical Devices & Pharmaceuticals	800 (6.7)	
(B) Repair and Maintenance Cleaning		
(i) General	25 (0.21)	
(ii) Electrical Apparatus Components & Electronic Components	100 (0.83)	



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 1171 05-01-2009]**

	CURRENT LIMITS*	EFFECTIVE 1/1/2010
SOLVENT CLEANING ACTIVITY (cont.)	VOC g/l (lb/gal)	VOC g/l (lb/gal)
(iii) Medical Devices & Pharmaceuticals		
(A) Tools, Equipment, & Machinery	800 (6.7)	
(B) General Work Surfaces	600 (5.0)	
(C) Cleaning of Coatings or Adhesives Application Equipment	25 (0.21)	
(D) Cleaning of Ink Application Equipment		
(i) General	25 (0.21)	
(ii) Flexographic Printing	25 (0.21)	
(iii) Gravure Printing		
(A) Publication	100 (0.83)	
(B) Packaging	25 (0.21)	
(iv) Lithographic (Offset) or Letter Press Printing		
(A) Roller Wash, Blanket Wash, & On-Press Components	100 (0.83)	



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 1171 05-01-2009]

	CURRENT LIMITS*	EFFECTIVE 1/1/2010
SOLVENT CLEANING ACTIVITY (cont.)	VOC g/l (lb/gal)	VOC g/l (lb/gal)
(B) Removable Press Components	25 (0.21)	
(v) Screen Printing	100 (0.83)	
(vi) Ultraviolet Ink/ Electron Beam Ink Application Equipment (except screen printing)	650 (5.4)	100 (0.83)
(vii) Specialty Flexographic Printing	100 (0.83)	
(E) Cleaning of Polyester Resin Application Equipment	25 (0.21)	

* The specified limits remain in effect unless revised limits are listed in subsequent columns.



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 404 02-07-1986]

The operator shall not discharge into the atmosphere from this equipment, particulate matter in excess of the concentration at standard conditions, shown in Table 404(a).

Where the volume discharged is between figures listed in the Table, the exact concentration permitted to be discharged shall be determined by linear interpolation.

For the purposes of this rule, emissions shall be averaged over one complete cycle of operation or one hour, whichever is the lesser time period.

TABLE 404(a)

Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter" Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions		Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions	
Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot	Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot
25 or less	883 or less	450	0.196	900	31780	118	0.0515
30	1059	420	.183	1000	35310	113	.0493
35	1236	397	.173	1100	38850	109	.0476
40	1413	377	.165	1200	42380	106	.0463
45	1589	361	.158	1300	45910	102	.0445



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 404 02-07-1986]**

Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions		Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions	
Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot	Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot
50	1766	347	.152	1400	49440	100	.0437
60	2119	324	.141	1500	52970	97	.0424
70	2472	306	.134	1750	61800	92	.0402
80	2825	291	.127	2000	70630	87	.0380
90	3178	279	.122	2250	79460	83	.0362
100	3531	267	.117	2500	88290	80	.0349
125	4414	246	.107	3000	105900	75	.0327
150	5297	230	.100	4000	141300	67	.0293
175	6180	217	.0947	5000	176600	62	.0271
200	7063	206	.0900	6000	211900	58	.0253
250	8829	190	.0830	8000	282500	52	.0227
300	10590	177	.0773	10000	353100	48	.0210
350	12360	167	.0730	15000	529700	41	.0179
400	14130	159	.0694	20000	706300	37	.0162
450	15890	152	.0664	25000	882900	34	.0148



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 404 02-07-1986]**

Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions		Volume Discharged Calculated as Dry Gas At Standard Conditions		Maximum Concentration of Particulate Matter Allowed in Discharged Gas Calculated as Dry Gas at Standard Conditions	
Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot	Cubic meters Per Minute	Cubic feet Per Minute	Milligrams per Cubic Meter	Grains per Cubic Foot
500	17660	146	.0637	30000	1059000	32	.0140
600	21190	137	.0598	40000	1413000	28	.0122
700	24720	129	.0563	50000	1766000	26	.0114
800	28250	123	.0537	70000 or more	2472000 or more	23	.0100



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





FACILITY PERMIT TO OPERATE UNIVERSITY OF CALIFORNIA, LOS ANGELES

APPENDIX B: RULE EMISSION LIMITS [RULE 405 02-07-1986]

The operator shall not discharge into the atmosphere from this equipment, solid particulate matter including lead and lead compounds in excess of the rate shown in Table 405(a).

Where the process weight per hour is between figures listed in the table, the exact weight of permitted discharge shall be determined by linear interpolation.

For the purposes of this rule, emissions shall be averaged over one complete cycle of operation or one hour, whichever is the lesser time period.

TABLE 405(a)

Process Weight Per Hour		Maximum Discharge Rate Allowed for Solid Particulate Matter (Aggregate Discharged From All Points of Process		Process Weight Per Hour		Maximum Discharge Rate Allowed for Solid Particulate Matter (Aggregate Discharged From All points of Process	
Kilograms Per Hour	Pounds Per Hour	Kilograms Per Hour	Pounds Per Hour	Kilograms Per Hour	Pounds Per Hour	Kilograms Per Hour	Pounds Per Hour
100 or less	220 or less	0.450	0.99	9000	19840	5.308	11.7
150	331	0.585	1.29	10000	22050	5.440	12.0
200	441	0.703	1.55	12500	27560	5.732	12.6
250	551	0.804	1.77	15000	33070	5.982	13.2
300	661	0.897	1.98	17500	38580	6.202	13.7
350	772	0.983	2.17	20000	44090	6.399	14.1
400	882	1.063	2.34	25000	55120	6.743	14.9
450	992	1.138	2.51	30000	66140	7.037	15.5
500	1102	1.209	2.67	35000	77160	7.296	16.1
600	1323	1.340	2.95	40000	88180	7.527	16.6



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765





**FACILITY PERMIT TO OPERATE
UNIVERSITY OF CALIFORNIA, LOS ANGELES**

**APPENDIX B: RULE EMISSION LIMITS
[RULE 405 02-07-1986]**

Process Weight Per Hour		Maximum Discharge Rate Allowed for Solid Particulate Matter (Aggregate Discharged From All Points of Process		Process Weight Per Hour		Maximum Discharge Rate Allowed for Solid Particulate Matter (Aggregate Discharged From All points of Process	
Kilograms Per Hour	Pounds Per Hour	Kilograms Per Hour	Pounds Per Hour	Kilograms Per Hour	Pounds Per Hour	Kilograms Per Hour	Pounds Per Hour
700	1543	1.461	3.22	45000	99210	7.738	17.1
800	1764	1.573	3.47	50000	110200	7.931	17.5
900	1984	1.678	3.70	60000	132300	8.277	18.2
1000	2205	1.777	3.92	70000	154300	8.582	18.9
1250	2756	2.003	4.42	80000	176400	8.854	19.5
1500	3307	2.206	4.86	90000	198400	9.102	20.1
1750	3858	2.392	5.27	100000	220500	9.329	20.6
2000	4409	2.563	5.65	125000	275600	9.830	21.7
2250	4960	2.723	6.00	150000	330700	10.26	22.6
2500	5512	2.874	6.34	175000	385800	10.64	23.5
2750	6063	3.016	6.65	200000	440900	10.97	24.2
3000	6614	3.151	6.95	225000	496000	11.28	24.9
3250	7165	3.280	7.23	250000	551200	11.56	25.5
3600	7716	3.404	7.50	275000	606300	11.82	26.1
4000	8818	3.637	8.02	300000	661400	12.07	26.6
4500	9921	3.855	8.50	325000	716500	12.30	27.1
5000	11020	4.059	8.95	350000	771600	12.51	27.6
6000	13230	4.434	9.78	400000	881800	12.91	28.5
7000	15430	4.775	10.5	450000	992100	13.27	29.3
8000	17640	5.089	11.2	500000 or more	1102000 or more	13.60	30.0



SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT
21865 Copley Drive, Diamond Bar, CA 91765

